



Design-in Guide

Reliable and flexible Xtreme technology

for demanding connected LED applications

Introduction to this guide

Thank you for choosing Xitanium LED Xtreme drivers. In this guide you will find the information needed to integrate these drivers into a LED luminaire or LED system.

This edition describes these driver families:

- Xitanium FULL Prog (Xi FP sXt)
- Xitanium LITE Prog (Xi LP sXt)
- Xitanium BASIC Prog (Xi BP sXt)

We advise you to consult our website for the latest up to date information.



Applications


Xitanium LED Xtreme drivers reduce complexity and cost of wireless connected lighting systems in outdoor and industrial applications. If you use Xitanium Xtreme CR drivers in combination with Xitanium Sensors and Xitanium LED modules then specific design-in guides are available from the below mentioned technology websites for further support.

Information and support

Please consult your local Signify office or visit our websites.

Design-in Support

Dedicated design-in support from Signify is available on request. For this service, please contact your Signify representative.

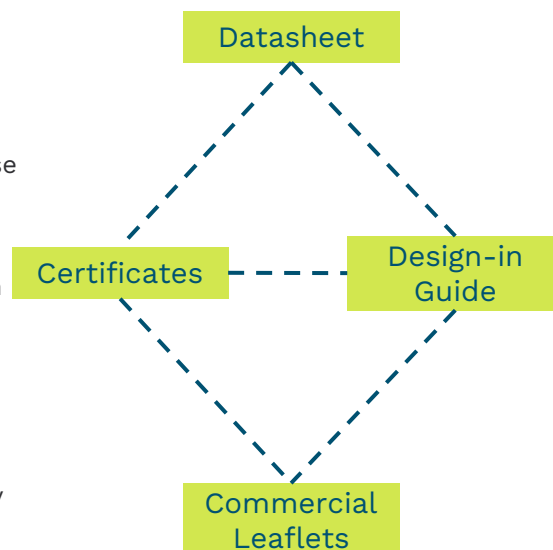

Document Overview

To provide information in the best possible way, Signify's philosophy on product documentation is the following;

- Commercial leaflet contains family information & system combinations
- Datasheet contains the product specific specifications.
- Design-in guide describes how the product must be used.
- Driver certificates list up-to-date compliance with relevant product standards.

All these documents can be found on OEM website. If you require any further information or support, please consult your local Signify representative.

Warnings and Instructions



Safety warnings



- Avoid touching live parts!
- Do not use drivers with damaged housing and/or connectors.
- Do not service the driver when the mains voltage is connected; this includes connecting or disconnecting the LED module.

Safety Warnings and installation instructions to be taken account during design-in and manufacturing.

- Do not use damaged products
- Do not connect mains voltage to the CR interface; immediate driver failure will result.
- The luminaire manufacturer is responsible for its own luminaire design and compliance with all relevant safety standards including minimum required IP rating to protect the driver.
- The Xitanium LED CR drivers are suitable for built-in use only and must be protected against ingress of and exposure to including but not limited to water, dust, insects or any other chemical agent - be it in the gaseous, vapor, liquid or solid form- which can be expected to have an adverse effect on the driver (e.g. use in wet/corrosive/dusty environments). It is the responsibility of both luminaire manufacturer and installer to prevent ingress and exposure. Any suggestion from Signify with reference to minimum required luminaire IP rating serves only as a non-binding guidance; a different IP rating may be required under certain application conditions to protect the driver. Common sense needs to be used to define the proper luminaire IP rating for the application.
- Do not service the driver when mains voltage is connected; this includes connecting or disconnecting the LED module. The driver generates an output voltage of the driver that may be lethal. Connecting a LED module to an energized driver may damage both the LED module and driver.
- No components are allowed between the LED driver and the LED module(s) other than connectors and wiring intended to connect the Xitanium driver to the LED module.
- Adequate earth and/or equipotential connections must be provided whenever possible or applicable.
- Signify Design-in support is available; please contact your Signify sales representative.

Xitanium LED Xtreme drivers

Xitanium LED Xtreme Drivers

Xitanium LED Xtreme drivers are designed to enable LED solution for general lighting applications. In the coming years LEDs will continue to increase in efficiency, creating generation and complexity challenges for OEMs. With Xitanium LED Xtreme drivers, flexibility in luminaire design is assured thanks to adjustable output current flexibility. Application-oriented operating windows offer the flexibility required to provide the stable lumen output and light quality levels that lighting specifiers and architects demand. The adjustable output current also enables operation of various LED PCB solutions from different manufacturers.



Examples of Xitanium LED Xtreme drivers

Xitanium LED Xtreme driver versions

The Xitanium LED Xtreme drivers described in this guide are available in multiple power and current ratings which enable the most popular light output levels for outdoor and industrial applications. It is always highly recommended to check our latest Xitanium LED Xtreme drivers leaflet for the most up-to-date overview of our range. This leaflet can be downloaded at www.lighting.philips.com/prof/led-electronics.

Detailed technical specifications can be found in the Xitanium driver datasheets at www.lighting.philips.com/prof/led-electronics.

Configurability Interface (tooling)

The Xitanium LED Xtreme drivers are configurable. A tailored package of features and parameters in these drivers can be set via a specific tool. This tool is the MultiOne Configurator. There are two types of interfacing technology used to communicate with this tool:

- DA Interface (wired)
- SimpleSet (wireless, based on Near Field Communication NFC)

SimpleSet

Philips SimpleSet wireless programming technology allows luminaire manufacturers to quickly and easily program Xitanium LED Xtreme drivers in any stage during of the manufacturing process without a connection to mains power, offering great flexibility. As a result, orders can be met faster while reducing cost and inventory.

For more information, please visit www.signify.com/oem

Xitanium LED Xtreme driver families: general feature overview

	Xi BP	Xi LP	Xi FP
Lifetime 100kHrs	•	•	•
Surge immunity medium / high	•/-	-/•	-/•
I-10V dimming (1-8 and 1-9V linear curve)		•	
LineSwitch Single-Step & 3-Step			•
Adjustable Output Current (AOC)	•	•	•
Wireless driver configuration (SimpleSet)	•	•	•
Constant Light Output, full (CLO)			•
Constant Light Output, basic (CLO LITE)		•	
Dynadimmer 5-step (incl. light turn-off)			•
Dynadimmer 5-step (no light turn-off)		•	
Event-based diagnostics	•	•	•
Realtime diagnostics			•
Module Temperature Protection (MTP)		•	•
Driver thermal protection (ThermalGuard)		•	•
Adjustable Driver Temperature Limit (DTL)		•	•
DALI 2 control			•
Mains voltage amplitude dimming (AmpDim)			•
Undervoltage protection (MainsGuard)		•	•
Coded control via Mains (CM)			•
DC emergency dimming (DCemDim)			•
Adjustable Startup Time (AST)			•
Resettable LED module operating hours (LSO)			•
Visual LED module End Of Life indication (EOL)			•
OEM Write Protection (OWP)	•	•	•

Note: Please refer to the applicable driver datasheet for an exact feature overview; depending on driver type not all indicated features may be supported.

Xitanium LED Xtreme drivers

Connected Ready (D4i) Interface (DA+/DA-)

Xitanium LED Xtreme drivers reduce complexity and cost of luminaires used in wireless connected lighting systems. They feature a digital DALI interface to enable direct connection to any suitable luminaire-based CMS (City Management System) controller or sensor. The result is a simpler, less expensive luminaire that enables turning every luminaire into a wireless node. The simple two-wire DALI interface is -dependent on driver type- compliant with D4i DALI Parts 250/251/252/253.

Compatibility with regular DALI and D4i devices

D4i Certified Products are designed to fully benefit from the CR driver capability. Xitanium CR drivers are also DALI-2 Certified. So, DALI-2 control devices can also be used together with Xitanium CR drivers, full functionality will be achieved using D4i control devices combined with D4i Xitanium CR drivers.

Compatibility with outdoor CMS systems

In the outdoor segment, the preferred option is to apply the CR driver in combination with the DALI interface for both the CMS nodes and potentially additional controllers. The Xitanium CR drivers can be used in combination with a DALI compliant device. However, a full system verification is advised to avoid high customer dissatisfaction and significant costs to repair.

Auxiliary Power Supply

Next to the switchable DALI PSU, the Xitanium LED Xtreme drivers are equipped with a permanently enabled auxiliary 24VDC power supply (+24VDC) which is short-circuit proof and intended to power auxiliary luminaire devices that need more power than the DALI PSU can deliver. This supply is compliant per DALI Part 150. More details about the auxiliary supply can be found in section Electrical design-in.

External DALI

As per DALI part 151 the Xitanium LED Xtreme drivers have elevated surge immunity and support extra-luminaire use with a total external cable length up to 15m. Please refer to the datasheet for immunity values.

DATA SPECIFICATIONS

	D4i requirement
DALI Part 251 – Luminaire Data	Mandatory
DALI Part 252 – Energy Data	Mandatory
DALI Part 253 – Diagnostics Data	Mandatory

POWER-SUPPLY SPECIFICATIONS

	D4i requirement
DALI Part 250 – Integrated Bus Power Supply	Mandatory
DALI Part 150 – AUX Power Supply	Optional

Xitanium LED Xtreme drivers

Adjustable Output Current (AOC)

Flexibility in luminaire design is ensured by the Adjustable Output Current feature (AOC). This feature enables operation of various LED configurations from different LED manufacturers whilst also ensuring the solution remains “future-proof” for new LED generations. The output current can be configured with the Philips MultiOne software and the SimpleSet interface. More information about AOC and how to set the output current can be found in the section Electrical design-in.

Driver Temperature Limit (DTL)

Adjustable limitation of thermal stress on the driver is made possible by the DTL feature on drivers by means of an NTC resistor integrated in the driver. Depending on luminaire design, DTL can also be used as alternative for MTP since the MTP feature is not available on CR drivers. More details about DTL can be found in the section Thermal design-in.

Dimming interface

Interfacing with the Xitanium LED Xtreme drivers can be done via control interfaces as listed below:

- DALI
- 1-10V
- Lineswitch
- Mains input (AmpDim and Coded Mains)

Supported control interfaces can be found in the naming of the drivers (see section Driver naming).

Amplitude Modulation (AM) dimming

Philips Xitanium LED Xtreme drivers dim the output to the LEDs by means of continuous Amplitude Modulation (AM) dimming of the DC output current. No Pulse Width Modulation (PWM) is applied across any part of the entire output current range. AM dimming guarantees the smoothest and flicker-free operation over the entire dimming range.

LED Module Temperature Protection (MTP)

Adjustable limitation of thermal stress on the LED module is made possible by the Module Temperature Protection (MTP) feature combined with an NTC resistor integrated in the LED module. More details about MTP and the NTC resistor can be found in the Section Thermal design-in.

Temporal Light Artifacts (flicker & stroboscopic effects)

A small inherent ripple is superimposed on the DC output current of Philips LED Xtreme CR drivers. This ripple consists of a low- frequency LF component (double the mains grid frequency) and a high-frequency HF component. This ripple current has such a low amplitude that Temporal Light Artifacts (flicker & stroboscopic effects) with camera systems other than possibly those for high-speed slow-motion HD recording is not expected. The ripple value of both LF and HF components are specified in the driver datasheet. The typical values for TLA parameters short term flicker value (PstLM) and Stroboscopic

Visibility Measure (SVM) can be looked up in the driver datasheet.

Xitanium LED Xtreme drivers

Hot-wiring and output sharing



Warning: Xitanium Xtreme drivers do not support hot-wiring. In order to prevent damage to LEDs no connection or disconnection should be made to the driver output when mains voltage is present. Please ensure that power is turned off before doing so. Connecting multiple driver outputs in parallel or in series as well as the sharing of multiple LED+ or LED- connections in one wire is not supported either. Outputs of individual drivers must be kept fully separated.

Constant Light Output (CLO)

Traditional light sources suffer from depreciation in light output over time. This applies to LED light sources as well. The CLO feature enables LED solutions to deliver a constant lumen output throughout the life of the LED module. Based on the type of LEDs used, heat sinking and driver output current, a correction of the lumen depreciation can be entered into the driver. The driver then counts the number of operating hours and will correct the output current based on this input.

Since a CLO curve is not generic, the OEM needs to determine the appropriate CLO curve. This can be used to differentiate on e.g. lumen output or power consumption over lifetime.

The CLO feature can be programmed with the Philips MultiOne configurator tool. More information can be found on www.signify.com/oem

OEM Write Protection (OWP)

OWP allows the OEM to protect their driver setting over the lifetime of the driver by using a password. Drivers equipped with OWP will show this in the feature list if read out by the tool MultiOne. Specific features and also the OWP feature itself can be enabled and protected with that password to prevent unauthorized changes. The password management is under the responsibility of the company which is setting it.

Luminaire data

Xitanium LED Xtreme drivers are equipped with the Luminaire Info feature. This feature supports the extraction of luminaire data as input for system asset management and enables the OEM to issue a unique Global Trade Identification Number (GTIN). This feature is implemented in compliance with DALI Part 251 version 4.

DC mains operation

Xitanium LED Xtreme drivers support use in a DC power grid (e.g. central emergency system). The driver behavior once switched to DC input voltage can be programmed via MultiOne software. More details about DC input voltage suitability can be found in the driver datasheet.

Energy data

Xitanium Xtreme drivers have built-in energy measurement capability and can report energy and actual power consumption data. The metered data accuracy is equal to the accuracy as prescribed in EN50470-1 and EN50470-3, but its accuracy is not certified as such. Accuracy of the power measurement is the higher of following two values across the entire driver operating window: +/-4% of measured input power between %50-%100 load. The energy data feature stores energy reporting data in the nonvolatile memory bank provision specified in DALI-2 Part 252 and the D4i Certified specification.

Driver diagnostics & maintenance

Xitanium LED Xtreme drivers are equipped with a Diagnostics feature. The purpose of Diagnostics is based on the following:

- Readout of realtime driver diagnostic data (Xi FP drivers only).
- Readout of logged diagnostic data (event based)

Both support the gathering of information and to diagnose the history of the driver and connected LED module. The Diagnostics feature consist mainly of counters which keep track of specific variables like the number of startups of the driver, operating hours, temperature of driver and LED module, output current and voltages etc. When the driver is shutdown the diagnostics data is stored automatically in non-volatile memory.

The Diagnostics feature can be utilized programmed with the Philips MultiOne configurator tool. Select drivers also support diagnostics per DALI part 253. Both realtime and event-based diagnostic data can be obtained via the DALI interface of Xi FP drivers while SimpleSet supports reading out event-based diagnostic data. More information can be found at www.philips.com/multione.

Xitanium LED Xtreme drivers




Use in hazardous areas

Warning: the use of lighting control gear in hazardous areas is bound to very strict safety regulations. Xitanium LED Xtreme drivers are not certified per standard IEC/EN 60079 and latest EU directive ATEX for use in hazardous areas in which there is risk of explosion. Therefore, Xitanium LED Xtreme drivers do not directly support application in luminaires and lighting systems in such environments.

Driver naming

Xitanium LED Xtreme drivers are part of a specific naming system. See the example below.

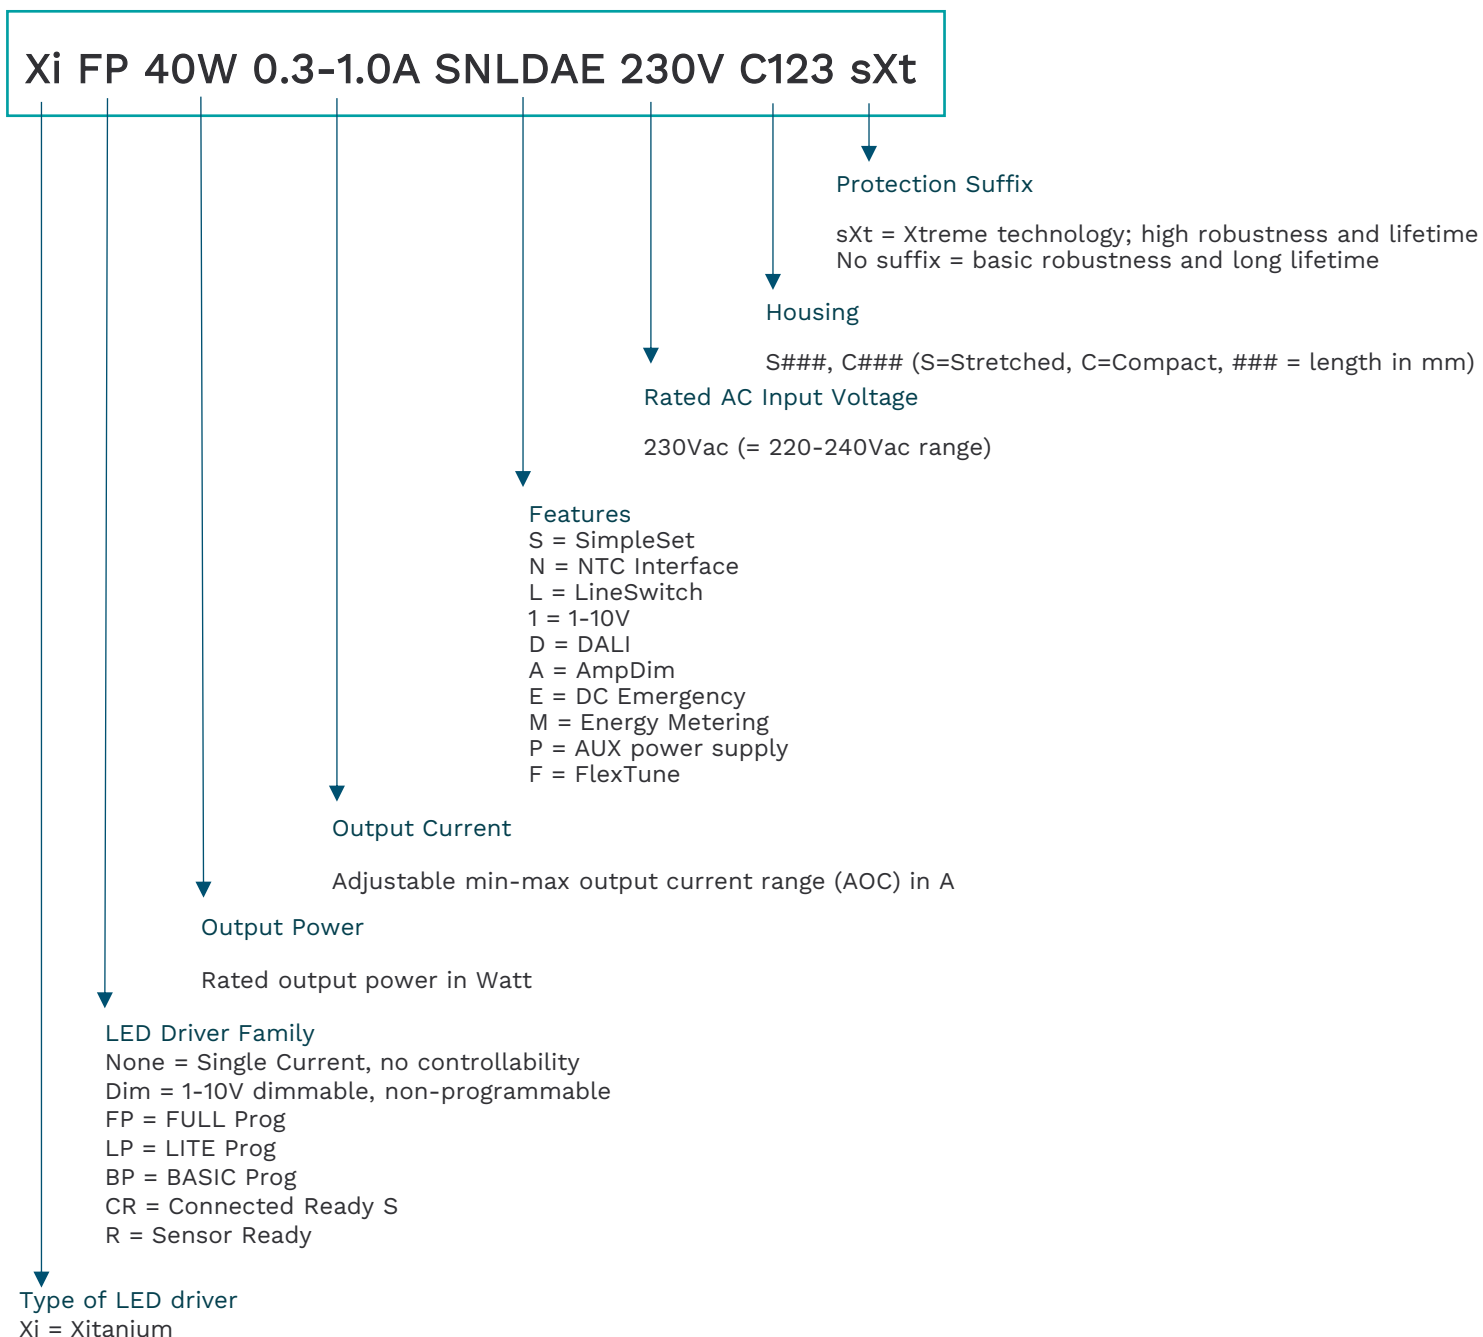

Mechanical Design-in

Dimensions

Xitanium LED Xtreme drivers are available in different housing dimensions. The specific dimensions can be found in the driver datasheet. 3D CAD files are available to verify fit and can be found at <https://www.lighting.philips.com/prof/led-electronics>.

It is recommended to build in drivers such that the driver housing and the driver input and output connectors are not affected by potential water ingress in the luminaire (e.g. due to luminaire sealing malfunction or condensation).

It is highly recommended to mount the driver by using all available mounting feet in order to achieve maximum mechanical robustness against shocks and vibration. The recommended mounting torque is 1.5Nm for drivers with plastic mounting feet. This value should not be exceeded in order to prevent deformation of the mounting feet.

Note: The use of rivets is not recommended since mounting torque cannot be controlled. Damage to the mounting feet and loose mounting may result.



Mounting screw dimensions should be based on the specified fixing hole diameter in the driver datasheet. Oversized and undersized screws should not be used in order to prevent damage to the mounting feet or loose mounting.

Allow for sufficient free space around the driver SimpleSet antenna if the driver is to be configured after mounting in the luminaire. The minimum recommended space is depending on the type of SimpleSet configuration tool. Using SimpleSet tool LCN9620, the minimum recommended distance is 19 mm (+/-1mm).

Depending on the application and the use in development, factory or field, another configuration tool can be selected. Please go to www.philips.com/multione to find the correct type. Every published interface tool is officially approved for use with the MultiOne software. The tool type number can be found by checking the LCN label on the tool itself.

Note: the use of an unapproved tool may result in impaired driver- tool communication and configuration malfunctioning.



LCN9620 SimpleSet interface tool

Thermal Design-in

Introduction

This section describes the following aspects of the thermal design-in of the Xitanium LED Xtreme drivers:

- The LED driver and the relationship between the tc point temperature and lifetime of the LED driver.
- The LED driver and its non-adjustable response to driver overheating (ThermalGuard).
- The LED driver and configurable Driver Temperature Limit(DTL) to maximize driver and possibly LED module lifetime in the application.

In order to facilitate thermal design-in of a LED driver, the critical thermal management points of the LED driver are set out in this section. Please familiarize yourself with the following key aspects to achieve optimal thermal design-in of the driver.

1: Driver case temperature point (tc point)

The driver case point temperature (tc) is the only reference for the temperatures of the critical internal driver components. The location of the tc point is identified on the driver type plate and is marked by a * or O symbol. Please use only the tc point as reference to define thermal suitability of a driver in the application. Its temperature can be measured using a thermocouple that is firmly glued to the tc point surface on the driver housing. For a representative measurement the temperature of the tc point must be stable before any reliable data can be obtained (typically > 3 hours or when the temperature difference is less than 1°C within one hour).

2: Driver T_{c_life} value

The specified full driver lifetime and corresponding failure rate will apply as long as the tc point temperature remains between the lower ta_min and upper tc_life limits.

3: Driver Tc_max value

The driver supports running at a higher temperature than the specified tc_life temperature, up to the tc_max temperature. Keep in mind that doing so will be at the expense of the driver lifetime and failure rate. A graphical representation thereof can be found in the driver datasheet. Running the driver above the specified tc_max temperature is not supported and will negatively affect driver lifetime and void driver warranty. The only way to verify whether either tc_life or tc_max is exceeded in the application is by using a thermocouple.

4: Driver minimum ambient temperature (ta_min)

This lower limit value as specified in the driver datasheet stipulates the minimum luminaire ambient temperature at which the driver can be used, e.g. in frozen storage warehouses or (sub)arctic areas. Using the driver below its specified minimum ta_min value is not supported and will negatively affect driver performance and lifetime. Driver warranty will then be void.

5: Driver minimum ambient temperature (ta_min)

Typically, the driver tc point will reach its specified tc_max value at the specified driver ambient ta_max temperature inside the luminaire. However, if the driver is not running at full output power, then the actual tc point temperature may be lower than the tc_max value. In that case a higher driver ta is supported up to the point when the specified tc_max value is reached.

6: Driver temperature readout in MultiOne Diagnostics



The "Driver temperature" readout via the Diagnostics function in MultiOne software represents the temperature of a driver-internal thermal sensor. Please do not use this readout to define thermal suitability of a driver for a given luminaire; this temperature readout does not represent the tc point temperature and does not correspond 1:1 with the tc point temperature. It is therefore not suitable as a reference for thermal design-in.

The thermal design-in of the driver inside the luminaire also influences the relation between the driver ta temperature and tc temperature. E.g. mounting the driver on an effective heatsink or placing it further away from LED modules will lower the tc value at a given ta. The tc point temperature is always leading with respect to tc_life or tc_max.

In general, lowering the overall driver temperature will increase the driver lifetime since the temperature of critical components inside the driver will be lower. However, applying only local heatsinking of the driver -e.g. to lower the tc point temperature or any other surface hotspot- will not necessarily lower the temperature of critical components. Do not apply local heatsinking to improve intended thermal driver performance and/or to artificially lower the temperature of the tc point.

Thermal Design-in

ThermalGuard


In a thermally well-designed luminaire, the specified t_{c_max} value will not be exceeded. However, under extremely hot atmospherical conditions the driver may occasionally overheat, in that case the driver will automatically start to reduce the output current as an emergency measure to reduce driver overheating. The result of the output current reduction will be a mitigation of the excess decrease of driver lifetime as a result of thermal overstress. Once the t_c point temperature starts dropping below a certain value the driver will automatically increase the output current up to the pre-set output current. If the output current reduction is not sufficient to counteract the t_c point temperature increase then the output current may either stabilize at a lower value or, depending on driver type, even be reduced to zero in extreme cases. This thermal driver protection feature is called ThermalGuard and its goal is to get the driver back in normal operating thermal conditions in which the specified driver lifetime can be met. Each driver type has its own specific factory default overheating behavior, and it can be found as a ThermalGuard graph in the driver datasheet.

Warning: the ThermalGuard feature is designed as a non-configurable emergency measure to protect the driver. It is not intended for structural activation to compensate for a poor thermal design of a luminaire. Structural activation will lead to premature driver and will void warranty.

Shown on the right is an example graph of the ThermalGuard feature. In this example, the output current is reduced from t_c point temperature of 86°C onwards down to 10% at 92°C. Between 92°C and 96°C the output current will remain at 10%. If the output current reduction is sufficient to decrease the t_c point temperature, then the output current will be increased accordingly up to the pre-set 100% level.

If the unlikely case when output current reduction is not sufficient to offset the t_c point temperature increase, then the output current is eventually reduced to zero at 96°C and the driver output will be switched off. Normal operation will not resume until the t_c point temperature has cooled down to 92°C. A power cycle is not required to resume driver operation. The 4°C hysteresis will prevent the luminaire from blinking on and off.

Note: The ThermalGuard feature is **non-configurable**.

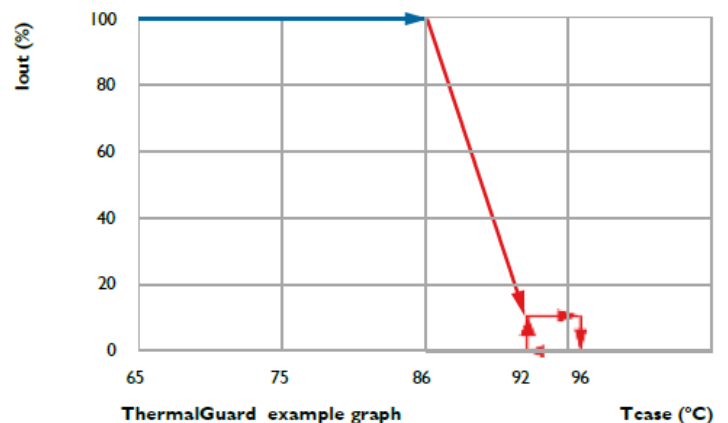

Thermal Design-in


Driver Temperature Limit (DTL)

Depending on commercial or application needs it may be required to optimize driver lifetime. This can be achieved by safeguarding that the maximum driver case point temperature in the application is not exceeding a predefined limit. A configurable feature called DTL (Driver Temperature Limit) enables this by offering an adjustable tc point temperature threshold at which the output current is reduced (start dim value) and optionally be switched off (shutdown value). DTL configuration can be done by MultiOne software. By factory default, the DTL feature is configured per the specified ThermalGuard graph for a driver as specified in the driver datasheet.

Shown on the left is an example DTL and driver lifetime example graph. The green line represents the output current as function of the tc point temperature with DTL activated through a custom profile based on the requirement that the driver lifetime be at least 75khrs. The red line represents ThermalGuard behavior. In this example, the output current is reduced from tc point temperature of 80°C onwards (start dim value) and the tc point will not exceed 86°C (shutdown value) whereas it would have been allowed to reach up to 96°C without this specific DTL profile.

Warning: thermal luminaire properties will influence the DTL activation points. Therefore, the configured DTL start dim and shutdown values must be verified case-by-case per driver-luminaire combination to ensure that the driver does dim and shut down at the correct tc point temperature in relation to the configured MultiOne start dim and shutdown values. Otherwise, DTL will act either at a too low or too high tc point temperature!

The DTL feature can also be applied as a substitute for Module Temperature Protection (MTP) to protect the LED module against overheating and to maintain a certain lumen maintenance. The advantage of using DTL for this purpose is that the additional NTC on the LED module plus required wiring can be omitted. However, DTL can only be used as such if the thermal relation between the driver tc point and LED module tc point temperature is well-defined. Therefore, a meticulous thermal investigation of the driver - LED module driver application is required to prevent DTL from being activated at a too low or too high LED module temperature.

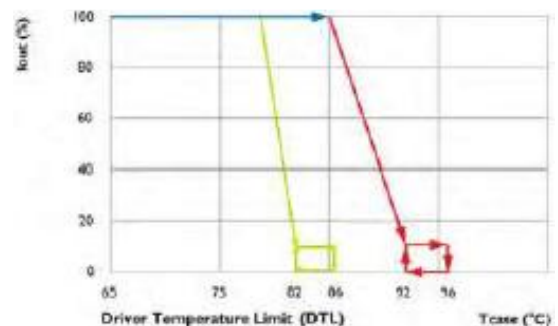

Thermal Design-in

LED Module Temperature Protection (MTP)

This feature helps to protect the LED module when operated during abnormal thermal application conditions. The thermal design of a LED module should be designed in such a way that the specified temperature of the LED module (tc(life) or tc(max)) is not exceeded under normal application conditions. The utilization of an NTC resistor interface (Negative Temperature Coefficient resistor) serves the purpose to help achieve the useful lifetime of the LED module if external thermal influences result in the temperature for lifetime tc(life) being exceeded. If this occurs then the light output will be reduced to keep the temperature of the LED module below a predefined critical temperature.

Philips Xi FP and Xi LP SN drivers are by default configured for the following three standard NTC types:

- 10 kilo Ohm NTC - Murata, p/n NCP18XH103J03R
- 15 kilo Ohm NTC - Vishay, p/n NTCS0805E3153GMT (previous p/n: 2381 615 54153)
- 15 kilo Ohm NTC - Murata, p/n NCP15XW153E03RC (+ separate 390 ohms resistor in series with the NTC)

Other NTC types are supported as long as they fall within a 5,000 ... 25,000 Ohm resistance range. The applicable values for R(25°C) and β however need to be specified separately during MTP configuration in MultiOne for proper MTP behavior.

MTP behavior setting

It is possible to set the temperature at which the MTP feature is activated, defined by "MTP warn" and the slope, defined by "MTP max". Using the MultiOne Configurator software these settings can be changed.

Note: Please take into account when verifying MTP performance in the application that MTP behavior will correspond with the configured MTP profile only when the driver tc point has reached at least its specified tc(life) temperature. At lower tc point temperatures the MTP may become active up to 10°C below the configured start dim temperature.



Warning: follow the instructions below for reliable MTP behavior and to prevent damage to the driver NTC interface.

- Do not combine the NTC ground connection (NTC COM) with the LED -connection. These two connections must be kept separate.
- The length of each wire between the NTC driver interface and the NTC on the LED module is not allowed to exceed 60cm. Do not use shielded wiring.
- It is neither allowed to connect multiple NTC inputs from multiple drivers in parallel nor to have multiple NTC interfaces share a common connection. Always keep multiple NTC interfaces fully separated from each other.

Electrical Design-In

Xitanium driver operating window


LED technology is rapidly evolving. The use of more efficient LEDs in a next generation means the same light output can be achieved with lower currents. At the same time, LEDs can be driven at different currents levels based on the application requirement. Typically, LED drivers are available in discrete current levels, e. g. 350 mA, 700 or 1050 mA. It is often necessary to replace a driver when more efficient LEDs or different LED modules become available.

One of the key features of the Xitanium LED Xtreme drivers is the adjustable output current (AOC) feature, offering flexibility and future-proof luminaire design. The Xitanium drivers can operate in a certain “operating window”. This window is defined by the maximum and minimum voltage and current that the driver can deliver. An example of an operating window is shown on the left. The area indicates the possible current/voltage combinations. The current selected will depend on the type and manufacturer of the LEDs or the specific LED configuration of the PCB design. The voltage is the sum of the LEDs used (total V_f string) and dependent on LED drive current and temperature. The operating window of every driver can be found in the driver datasheet.

The output current of these drivers can be set in two ways:

1. SimpleSet: output current can be set using the Philips MultiOne software and SimpleSet interface.
2. D4i interface: output current can be set using the USB2DALI interface LCN8600.

Warning: the forward voltage V_f of the connected LED module must remain within the specified driver operating window voltage boundaries under all application conditions. Otherwise, reliable luminaire operation cannot be guaranteed.

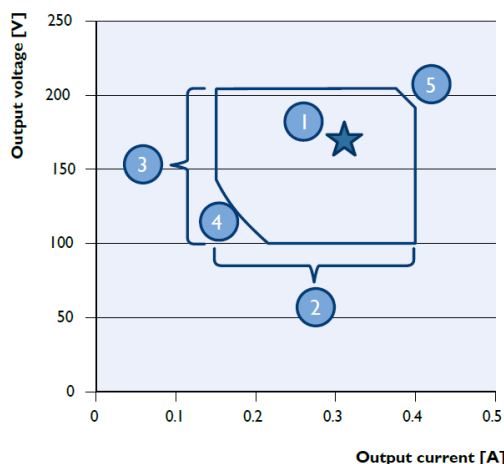


Dual-channel operation:

Drivers with a dual-channel output enable higher output current by connecting the two separate outputs in parallel. The actual output current will then be twice the configured value for AOC.

The outputs may also be connected separate from each other. The LED module voltage of the two channels is then allowed to be different from each other. The configured AOC value always applies to both outputs simultaneously.

See the connection diagrams on below for more details.

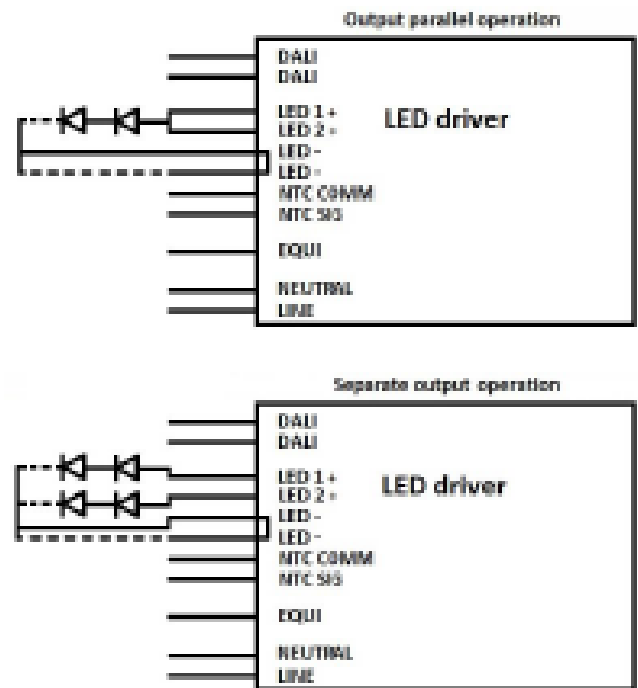

Example Operating window of a Xitanium driver

1. Required set point for the LED solution
2. Current can be set to needs within range
3. Driver adapts to required LED module voltage V_f , given it fits range
4. Driver minimum power limit
5. Driver maximum power limit

Electrical Design-In

How to select an appropriate driver

Depending on application requirements, several drivers may fit a specific application. The following steps will help in selecting the appropriate driver(s). For a complete overview of suitable driver(s) for your application, please use the Easy Design-in Tool (EDIT) at www.easydesignintool.philips.com as starting point.

1. Determine the required driver current (I_{drive}) and voltage (V_f)
2. Calculate the required power (P_{drive}) where $P_{drive} = V_f \times I_{drive}$ (W)
3. Select the datasheets from the website mentioned above based on the driver having a higher power than required.
4. Does the required current fit the current range of the driver? The current range of the driver can be seen in the name itself. For example, for driver Xi 75W LP 0.2 – 0.7A S1 230 V S240 sXt, the minimum programmable driver current is 0.2A and maximum is 0.7A.
5. Does the required LED voltage fit the voltage range of the driver? The exact values can be found in the datasheet.
6. Does the required power fit the power range of the driver? In the naming of the driver, you can see the maximum possible output power. For example, for driver Xi 150W LP 0.3-1.0A SL 230V S240 sXt, the maximum output power is 150W.
7. Choose the preferred dimming method. Please refer to the section about naming of the drivers to know what the naming indicates about dimming options.

Programming the output current

The Xitanium LED Xtreme drivers offer an extensive range of controls, enabling customizable luminaire design and performance. It is possible to control light output levels, preset dimming protocols and set system specifications in the factory and even in the complete installations.

This can be done with the Philips MultiOne configurator. The MultiOne configurator is a versatile tool that unlocks the full potential of all programmable drivers from Philips, ensuring that the driver performance matches the needs of the lighting solution. It offers unprecedented flexibility, before, during and after the product installation.

Programming of new Xitanium LED Xtreme drivers can be done either by using the SimpleSet or the DA interface.

For more information on MultiOne please refer to the section Driver Configuration or visit: www.philips.com/multione. This site contains detailed information on how to install the software and how to program the driver.

Connectors

Philips Xitanium LED Xtreme drivers are equipped with push-in type connectors. Connectivity specifications (wiring connection diagram, supported wire cross section range in mm², strip length range in mm and wire type) can be found in the driver datasheet.

Notes:

For currents between 1.0 and 1.5A (rms/DC) per connector, a minimum cross section of 0.75mm² is recommended.

In certain luminaire wiring scenarios two wires may have to be connected to one connector terminal. In that case, the pairing has to be done outside the driver, resulting in only one wire going into the connector terminal. Two wires into one connector terminal are not supported.

The reliability of twin-wire ferrules (or wire end stop), accepting the wires intended to use, should be checked with the supplier of these ferrules.

Mains operating conditions

Xitanium LED Xtreme drivers are designed for operation and performance by power sources or grids providing a clean and symmetric sinusoidal voltage wave form. They do not support operation on power sources including but not limited to having e.g. a square-wave voltage form or a "modified sinewave".

Xitanium LED Xtreme drivers are able to withstand high and low mains voltages for a limited period of time. This includes under- and overvoltage due to malfunction such as a loose neutral wire in the grid.

Low and High mains voltage

Xitanium LED Xtreme drivers are designed to be operated at mains under- and overvoltage per IEC requirements for performance and operational safety with respect to specified rated input voltage range.

The applicable lower limit for driver performance is lowest rated voltage -8% while -10% applies for driver operational safety. For drivers equipped with MainsGuard a lower limit applies for operational safety.

The applicable upper limit for driver performance is highest rated voltage +6 % while +10 % applies to driver operational safety.

The actual limit values can be found in the driver datasheet. For optimal luminaire performance it is always recommended to operate drivers within the specified voltage performance range.

Electrical Design-In

Output open-load and short-circuit conditions

Xitanium CR LED Xtreme drivers can withstand output open- load and short-circuit conditions. These are to be considered abnormal driver conditions. Consequently, it is not recommended to use drivers as such. Neither is it recommended to switch the driver output by means of e.g. relays ("hot switching") to connect or disconnect LED modules.

Excessive low mains voltage (MainsGuard)

Previously, LED Xtreme drivers would turn off the output in case of excessive low mains voltage. Depending on the exact driver type a shutdown would occur between 150 ... 180VAC.

This shutdown functionality was intended to prevent overcurrent conditions in the mains grid. Without shutdown the driver input current would increase proportionally with decreasing mains voltage since the driver is designed to maintain full light output of the luminaire and thus output power. This would exacerbate the overcurrent condition further. Consequently, mains cables and relays may be overloaded and melting fuses and/or MCBs may trip.

In order to prevent overcurrent conditions, a shutdown mechanism had been implemented in the driver. However, the main disadvantage of this shutdown is total loss of lighting.

Xitanium LED Xtreme drivers have a feature incorporated to protect luminaire and mains grid against overcurrent conditions without loss of lighting. This smart feature is called MainsGuard. Its function is to proportionally decrease input current as function of decreasing mains voltage and to keep doing so all the way down to a much lower mains voltage before the driver output is ultimately shut down. A small hysteresis of 5 ... 10Vac against on/off nuisance cycling is implemented before the driver output becomes automatically active again once the mains voltage starts to recover (no mains power cycle required).

A general graphical representation of MainsGuard can be seen in the illustration on the left. Exact values can be found in the MainsGuard graph in the driver datasheet.


Main benefits of MainsGuard are:

- Light will remain on, even at excessive low voltage
- Luminaire and grid are protected against undervoltage and over current
- No current overloading of MCBs, fuses, relays

Excessive high mains voltage

An excessive high mains voltage will stress the driver and will have an adverse effect on the lifetime. Xitanium LED Xtreme drivers will survive an input overvoltage of 264 ... 320Vac for a period of max. 48 hours and 320 ... 350Vac for a period of max. 2 hours.

A loose neutral condition has to be avoided as this may reduce the lifetime dramatically. Immediate driver failure may occur if the driver is connected to 400Vac as a result of a connection error in a 3-phase 230/400Vac grid.

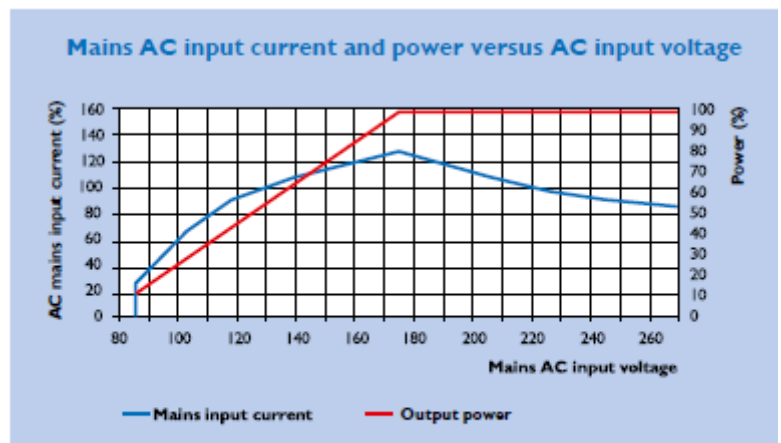

Illustrative graph of the MainsGuard feature. Shown values are example values. Please refer to the driver datasheet for exact values.

Note: the voltage levels at which output power is reduced and the output is eventually shut down and re-activated are fixed and cannot be modified.

Warning: the MainsGuard feature is designed as an emergency measure to protect the driver. It is not intended for structural activation to compensate for poor grid conditions.

Electrical Design-In

Power grids

Xitanium Xtreme LED CR drivers are suitable for direct connection to TN, TT and IT grids. Depending on driver type, a luminaire-based fuse in the driver neutral connection may be required in case both feeding phases are “hot”.

Note: certain restrictions apply for use in IT grids. Direct connection of Xitanium LED Xtreme drivers is only permitted in delta connection with a phase-to-phase voltage of 230Vac. In case the drivers are connected in star connection in a 230V/400Vac IT grid, the use of a separate 1:1 insulation transformer with sufficient power rating is required to power the drivers. The secondary output of the transformer must be connected to earth.

Power Factor (PF)

Xitanium Xtreme LED CR drivers have a high- power factor (PF) which is inherently capacitive. Its capacitive nature cannot be compensated for. The output power dependent PF graph can be found in the driver datasheet. By design, the driver will maintain a high-power factor also under dimming conditions.

Inrush Current


The term inrush current refers to the briefly occurring high input current which flows into the driver during the moment of connection to mains; see the illustration on the left. Typically, the amplitude is much greater than the steady-state input current. The cumulative inrush current of a given combined number of drivers may cause a Miniature Circuit Breaker (MCB) to trip. In such a case, either one or a combination of the following measures need to be taken to prevent nuisance tripping:

- Replace existing MCB for a less sensitive type
- Distribute the group of drivers over multiple MCB or phases
- Power up drivers sequentially instead of simultaneously.

Inrush parameters are driver specific and can be found in driver datasheet.

Notes:

- The amplitude and pulse width time of the inrush current are not in any way affected by the driver feature Adjustable Startup Time (AST, see section Control Features).
- Xi CR driver s are not equipped with an internal inrush current limiter.
- The use of an external inrush limiting device (e.g. EBN-OS or Camtec ESB) or a zero-voltage switching relay (e.g Finder 77 series) may enable a larger number of drivers to be connected to a MCB or fuse. Signify has not tested the compatibility or effectiveness of such third-party devices in the actual application. It is the responsibility of both luminaire manufacturer and installer to ensure compliance with national electrical codes when either device is used in the application.

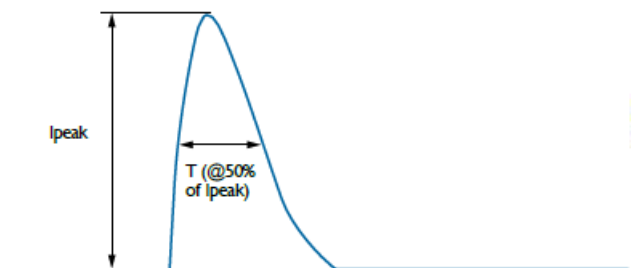

Graphical representation of inrush current

Electrical Design-In

How to Determine the Number of Drivers per MCB

The maximum recommended number of drivers connected to a Miniature Circuit Breaker (MCB) from inrush current perspective can be calculated with the help of the conversion table shown on the left. In this table the stated amount for a 16A B type MCB is used as reference (100%). The maximum recommended number of drivers for different types of MCB can be calculated by this formula:

Max. number of drivers = reference x relative number in %

This table only applies for drivers without the IntelliStart feature.

Example:

If the datasheet states a max. amount of 20 drivers on a 16A B type, then for a 13A C type the max. amount is $20 \times 135\% = 27$ drivers.

Note: Keep in mind that in case a D type MCB is used that the steady-state current loading may be the limiting factor instead!

How to determine the number of drivers on a melting fuse

The maximum recommended number of drivers on a melting fuse is defined either by the aggregate inrush current or the aggregate steady-state input current.

The number of drivers can be calculated, using the specified values in the datasheet of the maximum input current and inrush current (I_{peak} and T_{width}) as well as the melting integral I^2t value of the applied fuse as specified by the fuse manufacturer.

The melting integral value I^2t of the aggregate inrush current must be 50% below the specified melting integral value I^2t of the fuse in order to prevent melting of the fuse when the drivers are connected to mains voltage simultaneously. And the aggregate steady-state input current loading shall remain below 80% of the fuse rating to prevent overheating of the fuse.

The following formula can be applied to calculate the I^2t value of the driver inrush current:

$$I^2t = (I_{peak})^2 \times (0.8 \times T_{width})$$

MCB type	Rating (A)	Relative number of LED drivers (%)
B	4	25
B	6	40
B	10	63
B	13	81
B	16	100 (reference)
B	20	125
B	25	156
B	32	200
B	40	250
C	4	42
C	6	63
C	10	104
C	13	135
C	16	170
C	20	208
C	25	260
C	32	340
C	40	415
D	4	80
D	6	130
D	10	210
D	13	280
D	16	350
D	20	470
D	25	550
D	32	700
D	40	940
L, I	16	108
L, I	10	65
G, U, II	16	212
G, U, II	10	127
K, III	16	254
K, III	10	154

The max. recommended number of drivers in the table above is based on inrush current and only serves as guidance. The actual maximum amount in the application may differ; it is dependent on steady-state current, MCB brand/type and inherent MCB tolerances.

Notes: Specified maximum number of drivers is based on simultaneous switch-on, e.g. by a central switch or relay.

For multiple MCBs in one cabinet the de-rating of the MCB manufacturer for steady-state load needs to be followed. If the actual de-rating is unknown, then it is recommended to use a steady-state current de-rating of 0.8 by default. No de-rating is needed in respect to inrush current as this is not part of the thermal properties of the MCB cabinet.

The maximum number of drivers that can be connected to one 30mA Residential Current Device (RCD) is typically 30. However, the actual maximum amount depends on RCD brand and type so the actual number may vary and will have to be defined on-site.

Electrical Design-In

DC emergency operation (DCemDim) and fusing

Depending on driver type, the driver may be certified acc. IEC 61347-2-13 Part J for operation on a DC input voltage. As a result, the driver enables application in emergency luminaires in compliance with IEC 60598-2-22 excluding high-risk task areas. These drivers support operation both a flat DC input voltage as well as operation on rectified sinewave "joker" input voltage.

On most Xi FP drivers, the DC Emergency Dim feature named DCemDim is available. This feature allows a pre-defined dim level of the driver output to which the driver will switch over automatically once connected to a DC input voltage. Please note that the output current cannot reach more than 60% of the configured AOC value during DC operation.

The mains input of DC-rated drivers is not polarity-sensitive for DC input voltage and the driver is fully CISPR15 EMC-compliant when operated on a DC grid. Specific DC input voltage values can be found in the driver datasheet. The DC input is allowed to be a "joker voltage" (inverted sine wave). Depending on driver type, EL marking may apply. For those drivers the corresponding Emergency Output Factor EOFx range can be found in the driver datasheet.

Notes:

- The allowed DC input voltage range for safety and performance are listed in the driver datasheet. Values outside the performance range will have an adverse effect on the driver performance and reliability.
- During DC input voltage operation the output power of the driver is limited to max 60% of the output power at AC input voltage operation.

Xitanium LED Xtreme drivers are equipped with an internal fuse rated for AC and DC voltage operation. Therefore, an external DC voltage rated fuse is not required when the driver is connected to DC input voltage.

More on setting parameters of DCemDim can be found in the section "Controllability". Specific DC input requirements can be found in the driver datasheet.

Note: The allowed DC input voltage ranges for safety and performance are listed in the driver datasheet. Values outside that range will have an adverse effect on the driver performance and reliability.

Electrical Design-In

Surge Immunity

Xitanium LED Xtreme drivers have elevated differential-mode and common-mode surge immunity levels which by far surpass the requirements as defined by IEC. By design, the high immunity levels do not only safeguard reliable driver operation in the field but also provide high immunity for the connected LED modules, thus enabling a high surge immunity on system level. The driver immunity levels can be found in the driver datasheet. In order to achieve these high immunity levels, the driver EQUI terminal must be connected to the metal parts of the luminaire and LED module heatsink in all cases (Insulation Class I: also, to earth). Doing so will guarantee the specified surge immunity levels and will protect the driver and LED module against surge damage. Depending on the local conditions, additional protection against excessive high surge voltages may be required by adding an external Surge Protection Device in the luminaire and/or at installation level (column/distribution cabinet).

Touch Current

Xitanium LED Xtreme drivers are designed to meet touch current requirements for Insulation Class II applications per lighting control gear standard IEC 61347-1 in order to enable an easy design-in in Insulation Class II luminaires per IEC60598-1. The specified peak values can be found in the driver datasheet and refer to single-driver only level.

The insulation of the wiring to and from the drivers needs to be in compliance with IEC60598. Taking into account the double insulation of the driver between mains input and LED output, the (supplementary) output wiring insulation rating needs to be based on the specified maximum output voltage of the driver. See the driver datasheet for the specific value of this voltage.

Note: In a luminaire, the cumulative touch current may be higher since the LED module may introduce additional touch current. Precautions may be required on the luminaire level if multiple drivers are used in a single luminaire. Do not leave the EQUI terminal disconnected to lower the luminaire touch current; impaired EMC performance and reduced system surge immunity will result.

Electro-Magnetic Compatibility (EMC)

Electromagnetic compatibility (EMC) is the ability of a device or system to operate satisfactorily in its electromagnetic environment without causing unacceptable interference with other systems or being too susceptible for external emissions from other systems. Xitanium LED Xtreme drivers meet EMC requirements per CISPR15 for conducted and radiated emissions. This test is conducted with a reference setup that includes a driver and an LED module + heat sink combination mounted on a metal plate and verified in Insulation Class I and II configurations.

Remote mounting and EMC

Xitanium LED Xtreme drivers are designed for built-in use only and do not support remote mounting.

Signify has successfully performed CISPR15 EMC compliance tests on systems with a standard LED output cable length of 60cm as reference. For longer CISPR15-compliant cable lengths please check the driver datasheet for the maximum specified length.

If a longer distance beyond the maximum specified distance is required, then the EMC performance needs to be verified separately. The use of shielded LED output wires is not recommended.

Warning: the driver EQUI terminal must be connected to the luminaire chassis as well as to Protective Earth (Class I) for optimal EMC performance and surge immunity. Doing so for Class II luminaires is in safety compliance with IEC61347-1, IEC60598-1 and IEC61140 regarding the relation between the driver EQUI terminal and live parts with respect to:

- Maximum allowable touch current
- Minimum required insulation resistance
- Minimum required creepage distances and clearances
- Minimum required electric strength

The purpose of the driver EQUI terminal is purely for functional performance reasons by establishing equipotential bonding; the EQUI terminal does **not** have a safety function.

Electrical Design-In

EMC Performance Precautions

The following practical precautions need to be taken into account in a lighting system for optimal EMC performance:


- Minimize the loop area of the LED output wires going from the driver to the LED module by keeping the output wires close together (bundling).
- Minimize the parasitic capacitive coupling of the LED output wiring towards earth by keeping the wiring length as short as possible.
- Keep the length of the incoming mains wire inside the luminaire as short as possible.
- Keep mains wires, DALI control wires and LED output wires separate. Do not bundle or cross the wires.
- Do not route any wiring over and/or along the driver enclosure to avoid any noise coupling/crosstalk with internal driver circuitry.

Insulation Class I application: ground the luminaire chassis and other large internal metal luminaire parts (driver mounting plate, reflector, canopy, heat sink etc.) to Protective Earth. Always connect the driver equipotential connector (EQUI) to Protective Earth.

Insulation Class II application: use equipotential bonding wires between all large metal luminaire parts (driver mounting plate, canopy, heat sink etc.) Do not keep large metal parts electrically insulated. Always connect the driver equipotential connector (EQUI) for equipotential bonding.

Keep the equipotential wires as short as possible to maximize their effectiveness and use, as much as possible, large metal areas (chassis, mounting plates, brackets) for earthing purposes instead. Establish a reliable electrical connection by using a toothed washer and screw(s) fastened with adequate mounting torque.

Adhering to these rules will help to achieve EMC compliance. For further questions and/or design-in support please contact your local Signify representative.

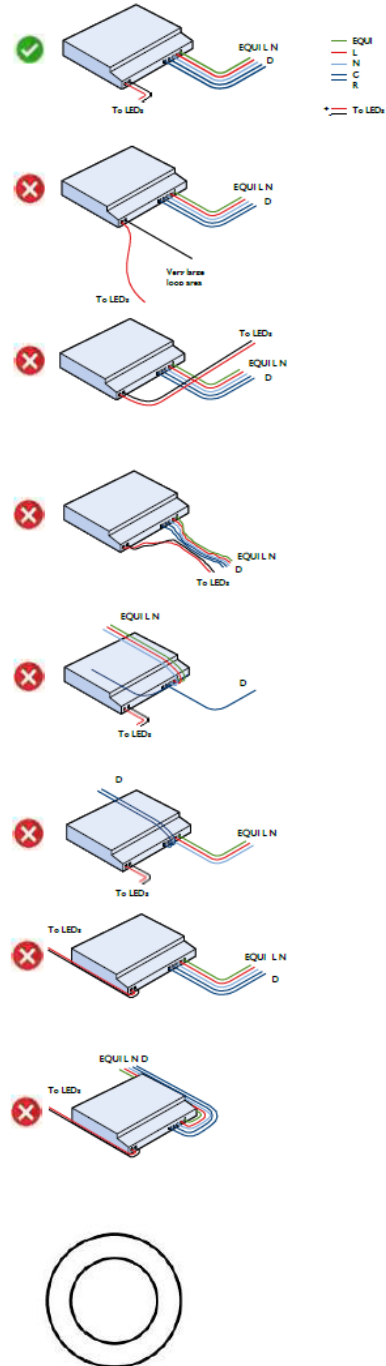


Driver Configuration

Introduction

The Xitanium LED Xtreme drivers offer a tailored range of controls, enabling customizable luminaire design and performance. It is possible to control light output levels, preset dimming protocols and set system specifications in the factory and even in the complete installations. This can be done with the Philips MultiOne configurator. The MultiOne configurator is an intuitive tool that unlocks the full potential of all configurable drivers from Signify, ensuring that the driver performance matches the needs of the lighting solution. It offers unprecedented flexibility, before, during and after the product installation. Programming of new Xitanium LED Xtreme drivers can be done either by SimpleSet or via the DALI interface with the USB2DALI interface.

For more information on MultiOne installation – software and programming: go to www.signify.com/oem

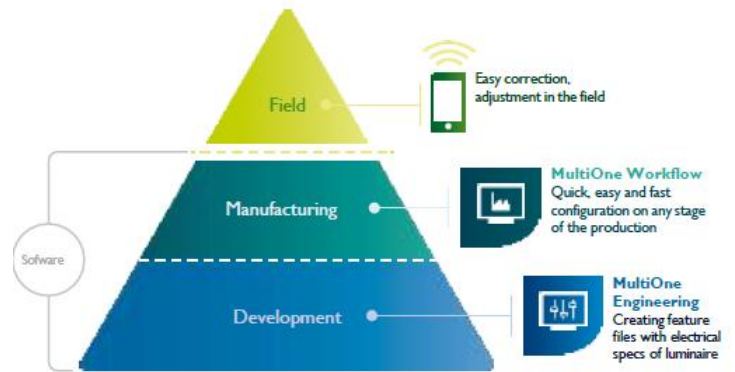

Control Features

Adjustable output current (AOC)

Applicable to: Xi FP / Xi LP / Xi BP drivers

AOC limits the driver output current to match the application requirement. The limited output current is then dimmable over the full user controllable dim range; the AOC level [mA] being the 100% light level. The default AOC value can be found in the driver datasheet.

Adjustable Light Output (ALO)

Applicable to : Xi FP drivers

ALO limits the light output of the driver to match the application requirement. The limited light output is then dimmable over the full user controllable dim range; the ALO level [%] being the 100% light level. Setting an ALO minimum level prevents the light from dropping below the set level during dimming conditions. This is a useful feature if a minimum light level needs to be maintained under all conditions.

ALO can also be used to permanently set the AOC value at a level below the minimum programmable AOC level. E.g. if the min. programmable AOC value of a driver is 200mA while the required AOC value is 160mA then the ALO feature must be enabled and set at 80%.

Depending on driver type, there are two ALO versions available: one version with and one without the option to set the ALO minimum level. Please check the driver datasheet to find out which ALO version is supported.

Driver Temperature Limit (DTL)

Applicable to: select Xi FP and select Xi LP S1 drivers

DTL supports thermal fine tuning of a lighting system via configurable parameters. See section Thermal Design-in for more details. Please check the driver datasheet to check whether DTL is supported.

Constant Light Output (CLO)

CLO: applicable to Xi FP drivers

CLO LITE: applicable to Xi LP drivers

CLO will gradually increase the light level over time from an initial lower light level up to 100% light level in order to compensate for LED module depreciation over life. It can also serve as a means to reduce energy consumption.

CLO settings include enabling disabling and redefining the CLO dimming curve. Changes are effective immediately. The allowed range for CLO is 0-100% with 1% increments (note that 0% results in the output being switched off. The 100% level corresponds with the configured AOC value or AOC + ALO values.

LED Module Temperature Protection (MTP)

Applicable to: Xi FP drivers

MTP is the method in which a thermal sensor (NTC resistor) implemented on the LED module is sensed by the driver, which will cut back output current when a predefined (temperature) limit is exceeded in order to protect the LED module from thermal overstress.

The driver accommodates for three NTC resistor choices. See the section Thermal Design-In for more details on NTC type.


End of life (EOL)

Applicable to: Xi FP drivers

EOL is providing a visual notification to a customer that the LED module has reached the end of its manufacturer- specified life and that replacement is recommended.

Once active, a visual indication is given at each power-up of the driver, after which the LEDs will flash for 2.5 seconds before normal operation is continued. See the illustration on the left.

A time slider is provided to set back the operating hours to zero in case the CLO feature is used. This will prevent a too high initial lumen output from a new replacement LED module.

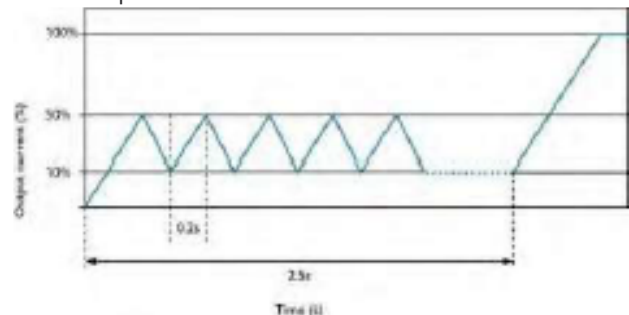

Adjustable Start-up Time (AST)

Applicable to: Xi FP drivers

The AST feature enables a time-adjustable gradual increase of the light level after powering up the driver, ensuring a smooth and comfortable transition from a low light level to the full light level. This ramp-up time is configurable via MultiOne software.

The initial low light level is fixed and will be either 10% of the configured AOC value or the absolute minimum output current of the driver, depending on which lower limit is reached first.

Note: the AST feature does not in any way influence the driver inrush current at mains turn-on.

Control Features

DC emergency dimming operation (DCemDim)

Applicable to: Xi FP drivers

Xi FP drivers are equipped with an auto-detect DC voltage feature. As soon as a DC input voltage is detected, the driver will automatically set the output current to a predefined configurable emergency dimming level.

Note: during DC operation the output current cannot be set higher than 60 % of the programmed AOC value applicable during AC operation.

The driver will ignore all DALI dimming and on/off commands when operated at DC input voltage unless the checkbox "allow dimming" in the DC Emergency tab is selected. Please refer to the datasheet to find out whether the "allow dimming" feature is supported.

Light Source Operating Hours (LSO)

Applicable to: Xi FP drivers

Light Source Operating: set a specific time or reset the operating hours, e.g. after replacing a LED module or driver with another (new) one. When CLO resp. CLO LITE is enabled it is recommended to set the correct light source age.

Control interface 1-10V

Applicable to: Xi LP S1 drivers

1-10V dimming provides a traditional way to control the driver output current down to 10% by means of an analog current-controlled voltage source (see graph on the left). The interface is designed to comply with IEC60929 Annex E. The driver dimming interface sources a current of 150µA. The applied 1-10V controller should therefore be able to sink the cumulative current sourced by the dimming interfaces of a group of connected drivers and must be of the two-quadrant type.

Depending on driver type, there are two linear dimming curves available that can be selected:

0-10V linear curve

- Minimum light output at 1V, max. light output at 8V and above
- Minimum dim level can be set at 10% and up in 1% increments.


1-9V linear curve

- Minimum light output at 1V, max. light output at 9V and above
- Minimum dim level has a fixed value of 10% and cannot be modified.


In applications with long 1-10V cables there will be a voltage drop which depends on the cable length, number of connected drivers and the wire cross section in mm². The maximum recommended voltage drop on the 1-10V dimming wires is 100mV to prevent differences in light level.

Note: the driver output cannot be turned off by pulling down the 1-10V interface to 0V. Between 0 and 1V, the minimum light output will be maintained.

Warning: the driver 1-10V control interface is classified as FELV and is not safe to touch! See the illustration on the next page for more details.

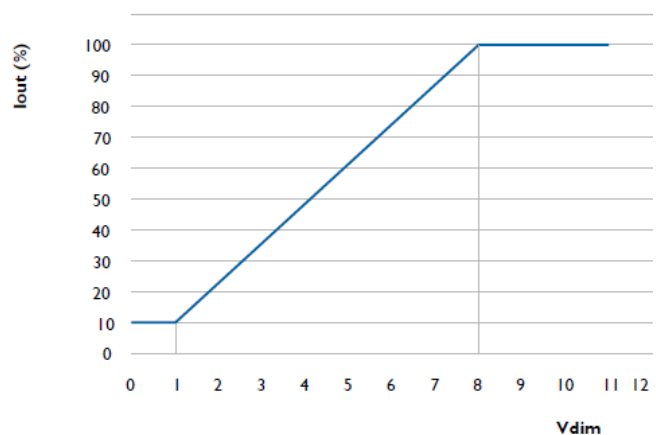

Output Current versus Voltage 0-10V linear dimming curve

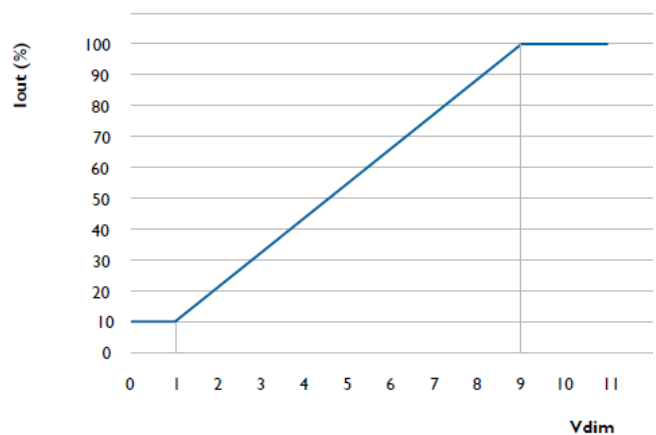

Output Current versus Voltage 1-9V linear dimming curve

Control Features

Dynadimmer

The Integrated Dynadimmer is an autonomous dimming control developed by Signify that enables simple, pre-programmed customized multistep dimming without the need for external control infrastructure. Its main function is energy reduction by reducing light levels or switching off the light during the night when it is not required to have full light output.

Dynadimmer operation override is possible by DALI commands at any time. Once in override mode, the driver will remain in DALI mode until the next mains power cycle.

This override does not interfere with the Dynadimmer synchronization algorithm.

Dynadimmer offers two options: time-based and location based.

The time-based option does not compensate for seasonal changes and starts executing the Dynadimmer profile as soon as power is applied to the driver. This option is best suited for applications with fixed power-on/off timing.

However, in most outdoor applications the timing will vary per season and the dimming schedule should thus be adapted accordingly. For this Signify has introduced the programmable Dynadimmer feature which simply uses the driver power-on time duration as reference.

Based on the average power-on time of the previous periods, the driver is able to estimate the current time of day and uses this as a virtual clock time which serves as reference for the dimming schedule programmed by the user.

The Dynadimmer feature relies on a regular power-on time from one night to the next. Typically, the power-on time is based on sunset and sunrise and its duration will vary gradually throughout the seasons. The Dynadimmer therefore calculates the power-on time average of the five last preceding stable nights. A stable night is regarded as a night with a power-on time of at least four hours within a tolerance of one hour that equals the latest calculated average power-on time. This implies that after first installation the Dynadimmer will need three stable nights to be able to calculate the virtual clock time required for the programmed dimming schedule. During this synchronization phase the Dynadimmer will not dim the light output for the first three nights.

Depending on geographical location or on the application, the switch-on time is not always evenly distributed around midnight. To be able to compensate for the difference in sunrise and sunset over a time zone, the user can set his geographical location in both western or eastern direction.

For example, if the sunset in Berlin is at 19:00 this will be in Poland at 18:25 and in Portugal 19:35. To be able to synchronize the absolute clock time with a photocell-controlled system in Poland the offset should be set at -25 minutes and for Portugal +35 minutes.

By default, the mid position of a time zone (in above time-zone this will be close to Berlin) will be selected; in most cases this default value will be accurate enough.

The midnight shift option is of course not available when the Time-based option has been selected.

Since the frequency of the power grid is used the accuracy of timing is very high and is typically far within 1%. Nearby luminaires connected on the same on/off cycle and programmed with the same Dynadimmer schedule will dim down and up simultaneously.

In normal operation mode (after the synchronization phase) the Dynadimmer will handle maintenance or short power interruption in correct ways, thus preventing dimming schedule disruptions.

Dynadimmer attention points

If after synchronization the change in power-on time is more than one hour, then the driver does not need three new power-on cycles for re-synchronization. Instead, the driver looks further back in the history of previous power-on cycles to calculate the virtual clock time. As long as there are three stable power-on cycles in the history of the last five power-on cycles, with all three having the same duration (i.e. less than one hour difference) the driver will still dim as scheduled. This mechanism will prevent disruptions of the Dynadimmer dimming behavior due to occasional mains black- and brownouts.

If the difference in power-on time duration is less than one hour, then this will represent normal operation in which the driver will average the last three power-on times as reference to calculate the virtual clock time. The dimming schedule will stay active while gradually adapting to the new power-on time. Below examples show the sequence of events as the on-time changes.

Control Features

Dynadimmer (cont'd)

Influence of mains interruption (blackout):

If the mains voltage drops to zero for more than one second, then the driver will record this as a power-off event and will try to re-calculate the virtual clock time again when power is restored. This only means that the driver will need to synchronize to the regular power-on time duration (see previous section). If the duration of a mains voltage drop to 0V is less than one second, then the Dynadimmer operation will continue and the Dynadimmer dimming cycle remains unaffected.

Influence of mains voltage dip (brownout):

The driver is robust enough to handle a mains voltage dip down to 25VAC for one minute without disruptions of the Dynadimmer timing. Light output will be less and may even drop to zero for the duration of the mains dip, but the dimming schedule will not be affected.

Temporary mains power-off (maintenance at night, blackout): If the power outage occurs within the first 4 hours of the night then a new night will be calculated on the remaining on-time. For the next night, the average on-time before the outage will be used as reference. Hence, it won't affect the dimming duration of the next night and regular dimming will result. If the power outage takes place after more than four hours and not closer than at least one hour before the expected end of the night, then this deviating on-time will be taken into account to calculate the average power-on time of the five preceding nights. However, it won't affect the dimming duration of the next night. If the outage takes place within one hour before the expected end of the night, then this deviating power-on time will be taken into account as a valid night to calculate the average power-on time of the three preceding nights. This will then temporarily affect the dimming behavior.

Temporary mains power-on (maintenance during the day):

If the power-on time is less than four hours, then this deviating power-on time will be ignored and the average power-on time before the deviation will be used as reference. Hence, it won't affect the dimming duration of the next night. If the power-on time is more than four hours and at least one hour less than the average power-on time of the three preceding nights, then this deviating power-on time will be taken into account to calculate the average on-time of the five preceding nights. However, it won't affect the dimming duration of the next night.

Notes:

The Dynadimmer does not compensate stepwise for the 1-hour shift in time due to daylight savings time changes in fall and spring.

The Dynadimmer feature does not support 24h applications (e.g. tunnels, warehouses). A power off/on cycle is required every 24 hours

Control Features

DALI


Digital Addressable Lighting Interface (DALI) is a digital communication protocol commonly used in lighting systems. This protocol is standardized by IEC and there are many control devices from Signify and other manufacturers that communicate using DALI. The voltage across DALI wires is typically 16V and it is polarity insensitive. Using DALI, it is possible to send dimming commands (1-254 levels), set fade rates and fade times, query driver or LED status, etc. The Xitanium LED drivers also respond to public LED-specific DALI commands, for example: Query if the LED module is short-circuit or open-circuit.

For more information on DALI, refer to IEC62386 for more details. Specific driver DALI compliance can be looked up at the DIIA site: www.digitalilluminationinterface.org/products.

Warning: the driver DALI control interface is classified as FELV and is not safe to touch! See the illustration on the left for more details.

DALI curve setting

The DALI dimming curve can be set to linear via MultiOne software by using the Commands tab > Commander > Configuration > Device_Type_6 _Select_Dimming_Curve and setting DTR0 at value 1. Value 0 can be chosen for DTR0 to revert to the logarithmic dimming curve.

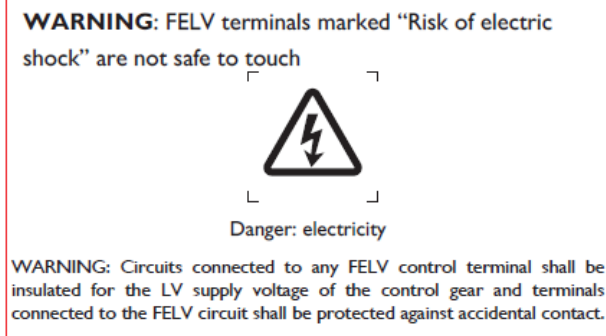

By default, both the DALI interface and LineSwitch interface are enabled with LineSwitch being set as primary interface. On reception of a DALI frame, the driver will switch over to DALI mode and all other interfaces will be ignored until the next mains cycle. If LineSwitch is enabled then the DALI System Fail Level and Power On Level will be inactive. In order to obtain full DALI compatibility in DALI-only applications it is therefore highly recommended to disable the LineSwitch feature via the MultiOne configurator.

The DALI interface of the driver is not designed to handle differential-mode mains voltage. Driver damage may result if mains voltage is applied to both DALI terminals.

Control Features

DALI


Digital Addressable Lighting Interface (DALI) is a digital communication protocol commonly used in lighting systems. This protocol is standardized by IEC and there are many control devices from Signify and other manufacturers that communicate using DALI. The voltage across DALI wires is typically 16V and it is polarity insensitive. Using DALI, it is possible to send dimming commands (1-254 levels), set fade rates and fade times, query driver or LED status, etc. The Xitanium LED drivers also respond to public LED-specific DALI commands, for example: Query if the LED module is short- circuit or open-circuit.

For more information on DALI, refer to IEC62386 for more details. Specific driver DALI compliance can be looked up at the DIIA site: www.digitalilluminationinterface.org/products.

Warning: the driver DALI control interface is classified as FELV and is not safe to touch! See the illustration on the left for more details.

DALI curve setting

The DALI dimming curve can be set to linear via MultiOne software by using the Commands tab > Commander > Configuration > Device_Type_6 _Select_Dimming_Curve and setting DTR0 at value 1. Value 0 can be chosen for DTR0 to revert to the logarithmic dimming curve.

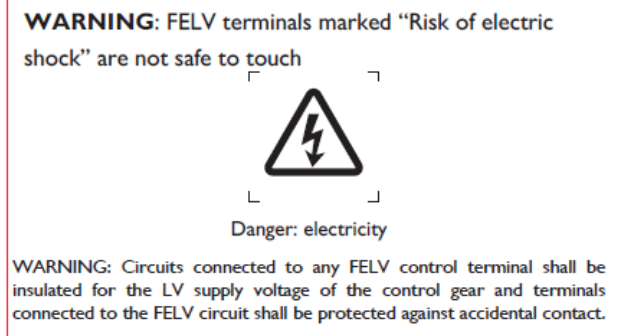

By default, both the DALI interface and LineSwitch interface are enabled with LineSwitch being set as primary interface. On reception of a DALI frame, the driver will switch over to DALI mode and all other interfaces will be ignored until the next mains cycle. If LineSwitch is enabled then the DALI System Fail Level and Power On Level will be inactive. In order to obtain full DALI compatibility in DALI-only applications it is therefore highly recommended to disable the LineSwitch feature via the MultiOne configurator.

The DALI interface of the driver is not designed to handle differential-mode mains voltage. Driver damage may result if mains voltage is applied to both DALI terminals.

Control Features

LineSwitch

Applicable to: Xi FP drivers (except driver Xi FP 330W SNDAE C170)

The LineSwitch feature requires the use of an extra mains pilot line. This feature offers a dimming solution which enables dimming of groups of luminaires to a predefined level with only a simple switch controlled by a timer, presence detector etc. Dimming to the desired level (incl. output turn-off) can be achieved by either applying or disconnecting mains voltage to the LineSwitch driver interface. Connecting mains voltage to the LineSwitch interface will lead to a 'High' level ($>176\text{VAC}$). A 'Low' level ($<110\text{VAC}$) is obtained by disconnecting the LineSwitch interface from mains voltage.

Xitanium LED Xtreme drivers are by default programmed with single-step LineSwitch enabled for which the 'Low' level is defined as active (i.e. no dimming when the LineSwitch input is left open). Just like the driver mains input, the LineSwitch interface also has high surge immunity. The immunity level can be found in the driver datasheet.


All parameters of LineSwitch including ramp-up and fade-down times can be programmed via the MultiOne configurator.

Two versions of LineSwitch are offered: single-step and 3-step.


Single-step LineSwitch can provide one dimming level while the 3-step LineSwitch offers the configuration of two additional optional dimming levels plus configurable delay times. See the illustrations below for further details.

Note: LineSwitch is -optionally- able to override Dynadimmer operation to temporarily set the light output to another light level, e.g. in case of emergencies or other special conditions that require a different illumination level. Once the override is deactivated Dynadimmer operation will be resumed.

Please refer to the MultiOne software user manual for more details regarding the override function.

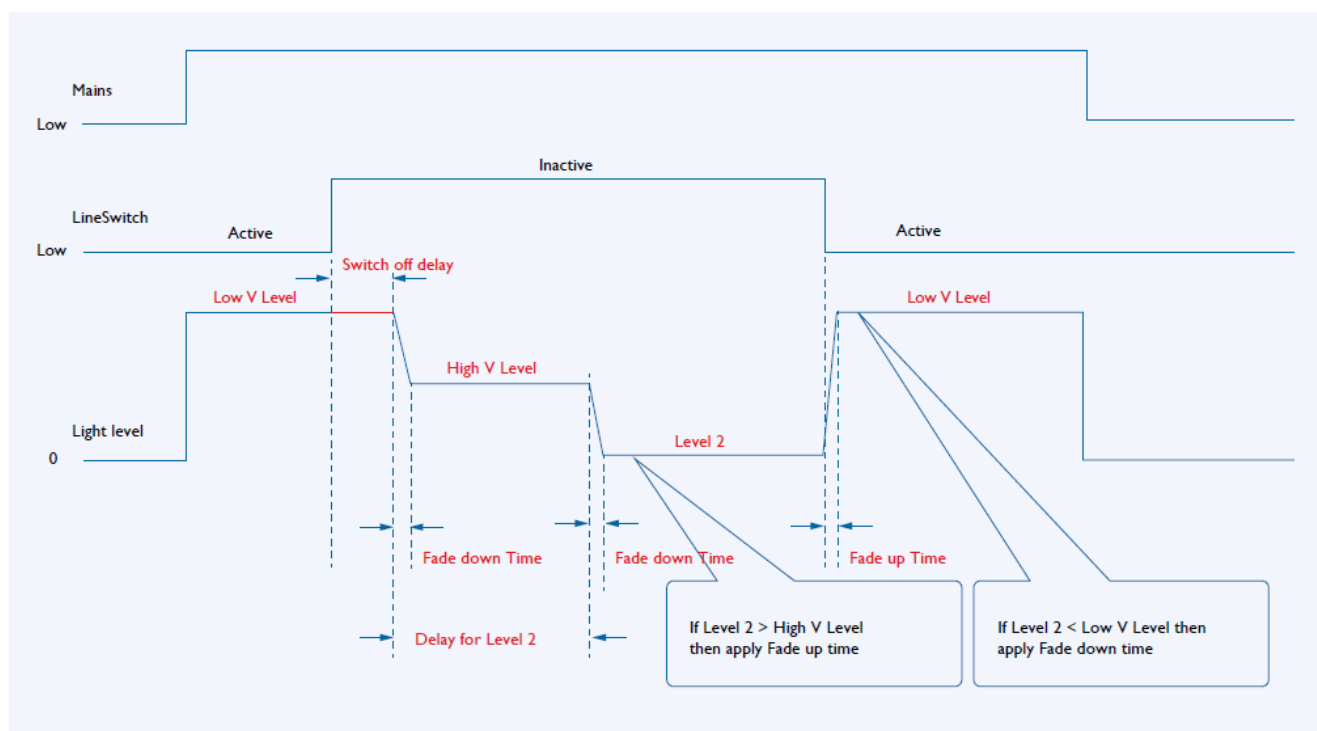

Control Features

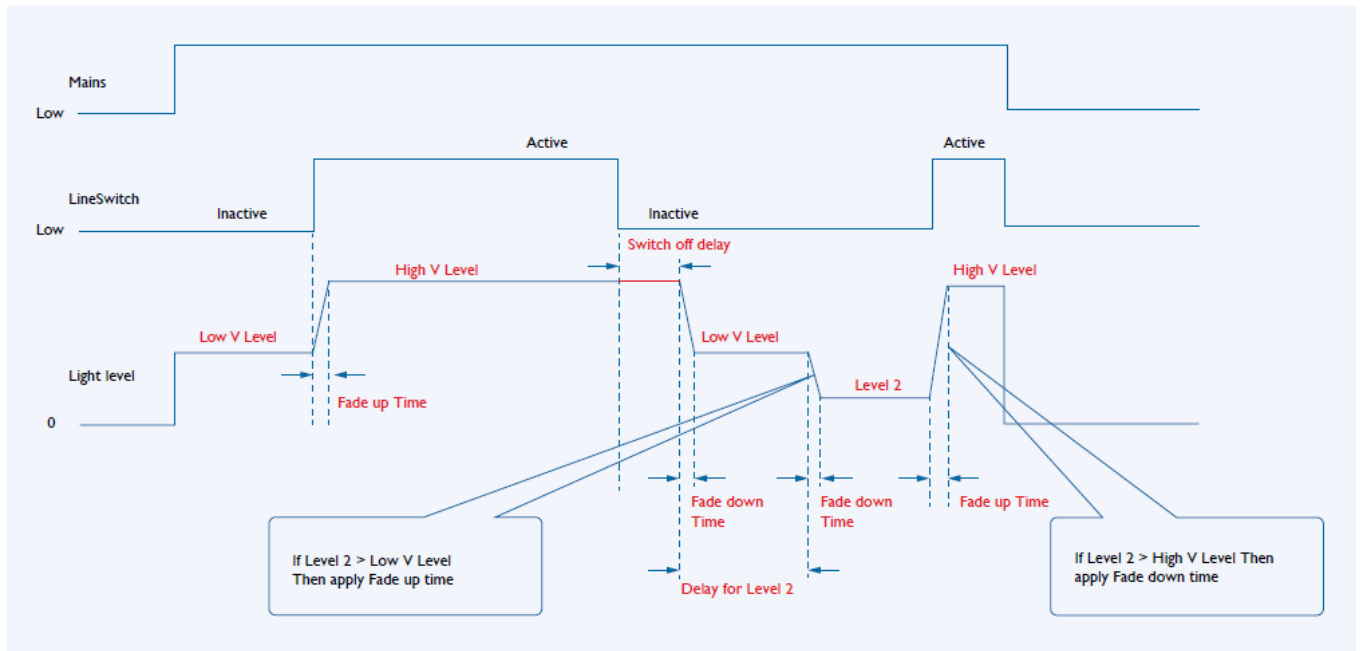

Note: Note: For proper functionality of the LineSwitch function the length of the LineSwitch pilot line from one luminaire to the next has a restriction. The restriction is given in the below formula:


$$\frac{(\sum L)}{\#D} \leq 56$$

In this formula:

L = length of the cable from cabinet to the LED driver in metres

#D = number of connected drivers

Example:

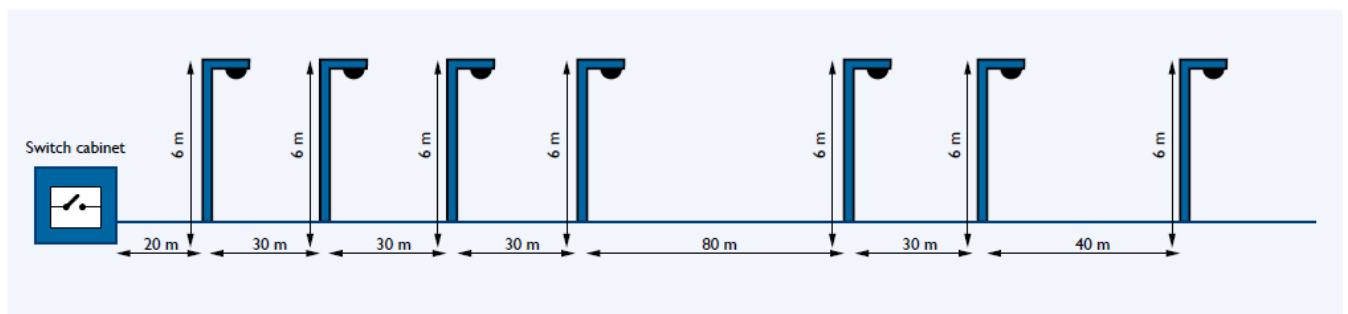

$$\frac{\sum(L)}{\#D} = \frac{26 + 4(36) + 86 + 46}{7} = 43.1 < 56\text{m} : \text{OK}$$

Control Features

If the distance conditions shown above cannot be met then longer driver-to-driver distances can be realized by adding an external capacitor between the switched pilot line and neutral. This capacitor needs to have a 275VAC voltage rating or more and X1 classification and should be added either in the luminaire or centrally in the switching cabinet. A capacitance value of 10nF allows for 60m extra pilot line length while a 100nF value allows for an additional 600m of length. Additional reactive power loading as a result of adding this capacitor is negligible.

In this example the following assumptions have been made:

1. Luminaires are used in a TN or TT power grid.
2. The parasitic capacitance in the mains cabling between the floating pilot line and the live phase is 100pF/meter.
3. No other loads are connected between the pilot line and other phases.
4. Other loads between the pilot line and neutral are allowed. In general this will increase the maximum acceptable cable length.

Warning: LineSwitch operation is not supported when drivers are connected in line-line connection in a 3-phase or 2-phase grid.

Control Features

AmpDim

Applicable to: Xi FP drivers


Historically, mains voltage dimming was used on magnetic ballasts to dim conventional HPS lamps. By lowering the mains voltage, a proportionate reduction in light output was achieved. Until now electronic ballasts were not able to replicate this function. AmpDim enables cabinet-based dimming without the need for additional control wires or other infrastructure changes.

A cabinet controller signals to the driver to lower the light output via a reduction in the amplitude of the mains voltage. The intelligence embedded in the LED driver allows for a configuration of a dimming level based on the amplitude of the mains voltage.

The configurable voltage range of AmpDim is 170 ... 250VAC while the configurable light level range is 30 ... 100%. Both can be set in increments of 1V and 1% respectively.

Note:

- There must be minimum 20V difference between the mains voltage corresponding with 100% light output and the lower mains voltage corresponding with the configured minimum light output
- The AmpDim feature only supports dimming methods based on amplitude dimming with constant amplitude reduction without sinewave waveshape modification. Phase-cut dimming and frequency modulation is not supported. See the illustrations below for details.

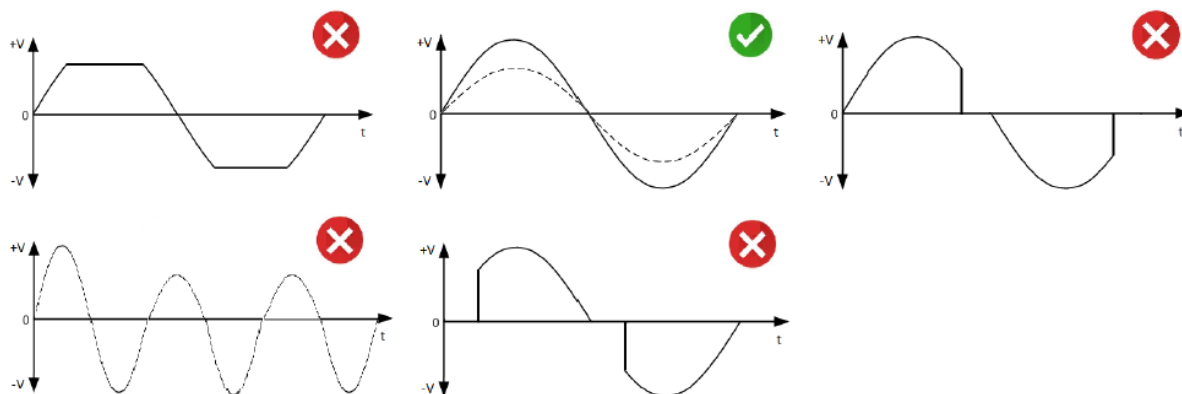

Control Features

Coded Mains

Applicable to: select Xi FP drivers

The feature Coded Mains (CM) supports the acceptance of dimming as well as on/off commands by the driver sent via the power grid. The commands are transmitted by an external cabinet CM controller and sent via the grid to the drivers. The CM feature supports controlling of road & street lighting applications only; the tunnel lighting application is excluded.

The cabinet controller signals to the drivers to change the light output via special commands superimposed on mains voltage. The intelligence embedded in the LED driver allows for a configuration of multiple dimming levels as well as on/off commands based on the specific command being transmitted.

The CM feature is -just like the LineSwitch feature- able to override Dynadimmer operation, provided the checkbox named Coded Mains Scene Settings is selected (see picture on the top left). Once override has taken place the driver will remain in CM mode until the next power cycle; Dynadimmer operation will then resume until the next CM command is detected.

If communications between CM controller and drivers is lost for more than 5 minutes then the drivers will change over to 100% light level by default (fallback level). This fallback level will be maintained until a CM command is detected or until a mains power cycle occurs. After a mains cycle, the driver will resume Dynadimmer operation until a CM command is detected.

In turn, DALI is able to override the CM feature at all times. The driver will then remain in DALI mode until the next power cycle; Dynadimmer operation will then resume until the next DALI command is detected.

Note: Coded Mains override by LineSwitch is not supported.

Warning: The Coded Mains configuration shows several editable parametric fields as shown in the bottom left picture. All values in these fields are NOT to be modified and must be left alone; otherwise CM malfunctioning may result!

Top Screenshot:

- Summary
- ALO
- AmpDim
- AOC
- CLO
- ↑ Coded Mains
- DC Emergency
- ↑ Dimming I...

Interface: Dynadimmer

Can be overridden by

- ☐ LineSwitch
- ☒ Coded Mains Scene Settings

Bottom Screenshot:

- Summary
- ALO
- AmpDim
- AOC
- CLO
- ↑ Coded Mains
- DC Emergency
- ↑ Dimming I...
- ↑ Dynadimmer
- EOL
- Light Source A...
- LineSwitch
- MTP
- Startup Time

☐ Override

Fade time: 7 s, 5,7 s

Fast fade time: 27 ms, 675 ms

Fallback detection time: 5 min

Power on level: 100 %

Scenes

Scene	Value (%)
Scene 0 / Fallback	100
Scene 1	0
Scene 2	1
Scene 3	10
Scene 4	35
Scene 5	50
Scene 6	60
Scene 7	75
Scene 8	80
Scene 9	85
Scene 10	90
Scene 11	95
Scene 12	100

☐ Keep last defined dim-level

WEEE Disposal Instructions

- EN** Please inform yourself about the local waste disposal, separation and collection system for electrical and electronic products and packaging. Please act according to your local rules and do not dispose your old product and packaging with your normal household waste. The correct disposal of the packaging, your product and/or batteries will help prevent potential negative consequences for the environment and human health. Batteries should be disposed separately from the municipal waste stream via designated collection facilities. When disposing a product that contains non-user replaceable batteries, the non-user replaceable batteries shall be removed by a professional.
- DE** Bitte erkundige Dich nach dem örtlichen Entsorgungs-, Trenn- und Sammelsystem für elektrische und elektronische Produkte und Verpackungen. Richte Dich bitte nach den geltenden Vorschriften in Deinem Land und entsorge Deine Altgeräte nicht über Deinen Haushaltsabfall. Durch die korrekte Entsorgung der Verpackung, Deines Produkts und/oder der Batterien/Akkus werden Umwelt und Menschen vor möglichen negativen Folgen geschützt. Batterien/Akkus müssen separat vom städtischen Abfallsystem über dafür vorgesehene Sammelstellen entsorgt werden. Bei der Entsorgung eines Produkts, das nicht vom Benutzer austauschbare Batterien/Akkus enthält, sollten die nicht vom Benutzer austauschbaren Batterien/Akkus von einer fachkundigen Person entfernt werden. Weitere Informationen über die Entsorgung Ihres Produktes und der Batterien finden Sie unter www.signify.com/de-de/sustainability.
- FR** Veuillez vous informer sur le système de collecte local, et sur la procédure de tri et de collecte des produits électriques et électroniques, et des emballages. Veuillez vous conformer aux consignes locales, et ne jetez pas votre ancien produit et son emballage avec les ordures ménagères. En respectant ces consignes pour mettre au rebut l'emballage, le produit et/ou les piles, vous contribuez à respecter l'environnement et la santé des personnes. Les piles ne doivent pas être mêlées aux ordures ordinaires, mais jetées sur des sites séparés prévus à cet effet. Lorsque vous mettez au rebut un produit contenant des piles non remplaçables, celles-ci doivent être retirées par un professionnel.
- NL** Houd rekening met het lokale systeem voor afvalscheiding en -inzameling wanneer u elektrische en elektronische producten of verpakkingen weggooit. Neem de lokale regelgeving in acht en gooi je oude producten en verpakkingen niet weg met het normale huishoudelijke afval. Het correct wegwerpen van de verpakking, het product en/of batterijen helpt mogelijke negatieve gevolgen voor het milieu en de menselijke gezondheid te voorkomen. Batterijen moeten gescheiden van huishoudelijke afvalstromen worden ingeleverd bij speciale inzamelpunten. Wanneer je een product weggooit met batterijen die niet door de gebruiker kunnen worden vervangen, moeten die batterijen door een professional worden verwijderd.
- ES** Infórmese sobre el sistema local de eliminación, separación y recogida de residuos de productos y envases eléctricos y electrónicos. Actúe de acuerdo con las normas locales y no tire el producto antiguo y su embalaje a la basura doméstica normal. La eliminación correcta del embalaje, de su producto y/o de las pilas contribuirá a evitar posibles consecuencias negativas para el medio ambiente y la salud humana. Las pilas deben eliminarse por separado del flujo de residuos municipales en las instalaciones de recogida designadas. Cuando deseche un producto que contenga pilas no sustituibles por el usuario, un profesional deberá retirar las pilas no sustituibles por el usuario.
- PT** Informe-se sobre o sistema local de eliminação, separação e recolha de resíduos de embalagens e produtos elétricos e eletrônicos. Proceda em conformidade com as regras locais e não elimine a produto antigo e a respetiva embalagem juntamente com os resíduos domésticos normais. A eliminação correta da embalagem, do seu produto e/ou das pilhas ajudará a prevenir potenciais consequências negativas para o ambiente e para a saúde humana. As pilhas devem ser eliminadas em separado do fluxo de resíduos urbanos através das instalações de recolha designadas. Quando se elimina um produto que contém pilhas não substituíveis pelo utilizador, estas devem ser removidas por um profissional.
- IT** Si prega di informarsi sul sistema locale di smaltimento, separazione e raccolta dei rifiuti per prodotti elettrici ed elettronici e imballaggi. Si prega di agire secondo le regole locali e di non smaltire il vecchio prodotto e l'imballaggio con i normali rifiuti domestici. Il corretto smaltimento dell'imballaggio, del prodotto e/o delle batterie aiuterà a prevenire potenziali conseguenze negative per l'ambiente e la salute umana. Le batterie dovrebbero essere smaltite separatamente dal flusso di rifiuti urbani tramite strutture di raccolta designate. Quando si smaltisce un prodotto che contiene batterie non sostituibili dall'utente, le batterie non sostituibili dall'utente devono essere rimosse da un professionista.
- DA** Hold dig orienteret om den lokale affaldsordning, -sortering og -indsamling for elektriske og elektroniske produkter og emballage. Følg de lokale regler, og bortsaf ikke dine udtjente produkter og emballage sammen med almindeligt husholdningsaffald. Korrekt bortsaffelse af emballagen, produktet og/eller batterier er med til at forhindre negative konsekvenser for miljøet og menneskers sundhed. Batterier skal bortsaffes separat fra den kommunale affaldsstrøm via særskilte indsamlingsordninger. Ved bortsaffelse af et produkt, der indeholder batterier, der ikke kan udskiftes af brugeren, skal batterierne fjernes af en fagperson.
- FI** Ota selvää paikallisesta sähkö- ja elektroniikkatuotteiden sekä pakkausten hävitys-, erottelu- ja keräysjärjestelmästä. Noudata paikallisia määräyksiä, äläkä hävitä vanhoja tuotteita ja pakkauksia tavallisen kotitalousjätteen mukana. Pakkauksen, tuotteen ja/tai paristojen asianmukainen hävittäminen auttaa ehkäisemään mahdollisia haittoja ympäristölle ja ihmisten terveydelle. Paristot on hävitettävä yhdyskuntajätteestä erillään määritettyjen keräyspisteiden kautta. Muuta kuin käyttäjän vaihdettavissa olevia paristoja sisältäviä tuotteita hävitettäessä muiden kuin käyttäjän vaihdettavissa olevien paristojen poistaminen on jätettävä ammattilaisen tehtäväksi.
- SV** Se till att skaffa dig kunskap om de lokala systemen för bortsaffande, sortering och insamling av avfall gällande elektriska och elektroniska produkter och förpackningar. Ågera i enlighet med lokala regler och släng inte bort din gamla produkt och förpackning tillsammans med vanligt hushållsavfall. Korrekt bortsaffande av förpackningen, din produkt och/eller batterier hjälper till att förebygga potentiella negativa konsekvenser för miljön och för människors hälsa. Batterier ska slängas separat från det kommunala avfallsflödet via särskilda insamlingsanläggningar. När du slänger en produkt som innehåller batterier som inte kan bytas ut av användaren ska de batterier som inte kan bytas ut av användaren avlägsnas av en yrkesperson.
- NO** Vennligst informer deg selv om det lokale avfallshåndterings-, separerings- og innsamlingssystemet for elektriske og elektroniske produkter og emballasje. Opptre i henhold til lokale regler og ikke kast det gamle produktet og emballasjen sammen med vanlig husholdningsavfall. Riktig avhending av emballasjen, produktet og/eller batteriene vil bidra til å forhindre potensielle skadelige følger for miljøet og personers helse. Batterier bør avhendes separat fra kommunalt avfall via anvisete innsamlingssteder. Ved kassering av et produkt som inneholder batterier som ikke kan skiftes ut av brukeren, skal batteriene som ikke kan byttes av bruker fjernes av en fagperson.
- EL** Ενημερωθείτε για το τοπικό σύστημα διάθεσης, διαχωρισμού και συλλογής αποβλήτων για ηλεκτρικά και ηλεκτρονικά προϊόντα και συσκευασίες. Ενεργείτε σύμφωνα με τους τοπικούς σας κανόνες και μην απορρίπτετε το παλιό σας προϊόν και τη συσκευασία του μαζί με τα συνήθη οικιακά απορρίμματα. Η σωστή απόρριψη της συσκευασίας, του προϊόντος σας ή/και των μπαταριών και η συμβάλει στην αποφυγή πιθανών αρνητικών συνεπειών που μαζι με τη συνήθη οικιακά απορρίμματα. Οι μπαταρίες θα πρέπει να απορρίπτονται χωριστά από το ρεύμα των αστικών απορριμμάτων μέσω των καθορισμένων εγκαταστάσεων συλλογής. Κατά την απόρριψη ενός προϊόντος που περιέχει μπαταρίες που δεν αντικαθίστανται από τον χρήστη, αυτές πρέπει να αφαιρούνται από επαγγελματία.
- TR** Lütfen elektrikli ve elektronik ürünler ve ambalajları için yerel atık atma, ayırma ve toplama sistemleri hakkında bilgi edinin. Lütfen bulunduğunuz bölgedeki yerel kurallara uygun hareket edin ve eski ürün ve ambalajınızı normal ev atıklarınızla birlikte atmayın. Ambalajın, ürününüzün ve/veya pillerin doğru şekilde atılması çevre ve insan sağlığı için olası olumsuz sonuçların önlenmesine yardımcı olur. Pillerin özel toplama tesisleri aracılığıyla belediye atık kolundan ayrı bir şekilde atılması gerekir. Kullanıcı tarafından değiştirilemeyen pil bulunan bir ürünü atarken pilin bir profesyonel tarafından çıkarılması gerekir.
- BG** Моля, запознайте се с местната система за изхвърляне, разделяне и събиране на отпадъци от електрически и електронни продукти и опаковки. Моля, действайте в съответствие с местните правила и не изхвърляйте стария продукт и опаковката заедно с обикновените битови отпадъци. Правилното изхвърляне на опаковката, на Вашия продукт и/или батерии ще помогне да се предотвратят потенциални негативни последици за околната среда и човешкото здраве. Батериите трябва да се изхвърлят отделно от потока на битовите отпадъци чрез определените за целта събирателни пунктове. При изхвърляне на продукт, който съдържа батерии, които не могат да се заменят от потребителя, същите трябва да бъдат отстранени от специалист.
- HU** Érdeklődjön az elhasznált elektromos és elektronikus termékek és csomagolásuk helyi szelektív gyűjtéséről és ártalmatlanításáról. Kövesse a helyi szabályozást, és ne helyezze az elhasználatott terméket háztartási hulladék-gyűjtőbe. A csomagolás, valamint az elhasználatott termék és/vagy akkumulátorok megfelelő ártalmatlanítása segít megelőzni a környezet és emberi egészség károsodását. Az akkumulátorokat külön, a helyi önkormányzat által megjelölt helyen kell gyűjteni, és nem szabad a háztartási hulladék közé keverni őket. A nem cserélhető akkumulátorokat tartalmazó termékek ártalmatlanításakor a nem cserélhető akkumulátorokat szakembernek kell eltávolítania.
- SL** Seznanite se z lokalnim sistemom odstranjevanja, ločevanja in zbiranja električne in elektronske opreme ter embalaže. Upoštevajte lokalno zakonodajo ter starega izdelka in embalaže ne odložite med običajne gospodinjske odpadke. S pravilnim odlaganjem embalaže, izdelka in/ali baterij med odpadke boste preprečili morebitne negativne posledice na okolje in zdravje ljudi. Baterij ne smete odložiti med gospodinjske odpadke, temveč na namenskih zbirnih mestih. Če odlagate izdelek, ki vsebuje baterije, ki jih uporabnik ne more zamenjati sam, bo takšne baterije odstranila strokovna oseba.

WEEE Disposal Instructions

- HR** Informirajte se o lokalnom sustavu za odlaganje, odvajanje i prikupljanje električnih i elektroničkih proizvoda i ambalaža. Postupajte u skladu s lokalnim propisima i ne odlažite stare proizvode i ambalaže s uobičajenim kućanskim otpadom. Ispravno odlaganje ambalaže, proizvoda i/ili baterija pomoći će u sprječavanju mogućih negativnih posljedica za okoliš i zdravlje ljudi. Baterije je potrebno odlagati odvojeno od komunalnog otpada na za to predviđenim odlagalištima. Kada odlažete proizvod koji sadrži baterije koje korisnik ne može samostalno zamijeniti, te će baterije ukloniti stručnjak.
- MK** Informirajte se za lokalni sistem za frlaње, одделување и собирање отпад од електрични и електронски производи и пакувања. Постапувајте во согласност со вашите локални прописи и немојте да ги фрлате стариот производ и пакувањето во обичниот отпад од домаќинството. Правилното фрлање на пакувањето, производот и/ли батериите ќе помогне да се спречат потенцијалните негативни последици за животната средина и човечкото здрање. Батериите треба да се фрлаат одделно од општинскиот систем за отпад преку назначени собирни објекти. Кога фрлате некој производ што содржи батерии што не може да се заменат, тие ќе се отстрануваат од страна на стручно лице.
- SR** Informišete se o lokalnom sistemu za odlaganje, odvajanje i sakupljanje otpada za električne i elektronske proizvode i ambalažu. Postupajte u skladu sa lokalnim pravilima i ne odlažite svoj stari proizvod i ambalažu sa uobičajenim kućnim otpadom. Pravilno odlaganje ambalaže, proizvoda i/ili baterija će pomoći u sprečavanju potencijalnih negativnih posledica po životnu sredinu i zdravlje ljudi. Baterije treba odlagati odvojeno od toka komunalnog otpada putem određenih objekata za prikupljanje. Kada odlažete proizvod koji sadrži baterije koje ne može zameniti korisnik, te baterije će ukloniti profesionalac.
- CZ** Informujte se o místním systému likvidace a tříděného sběru elektrických a elektronických výrobků a balení. Postupujte v souladu s místními předpisy a nevyhazujte staré výrobky do běžného komunálního odpadu. Správná likvidace produktů a baterií přispívá k ochraně případných nežádoucích vlivů na životní prostředí a zdraví osob. Baterie je třeba zlikvidovat samostatně mimo veřejné skládky prostřednictvím specializovaných sběrných míst. Při likvidaci výrobku obsahujícího baterie, které nejsou uživatelsky vyměnitelné, musí uživatelsky nevyměnitelné baterie vyjmout odborník.
- SK** Zistite si informácie o miestnej likvidácii odpadu, systéme separovaného zberu elektrických a elektronických výrobkov a obalov. Postupujte v súlade s miestnymi predpismi a nevyhadzujte staré výrobky do bežného komunálneho odpadu. Správna likvidácia produktov a batérií prispieva k zabráneniu prípadným nežiaducim vplyvom na životné prostredie a zdravie osôb. Batérie treba zlikvidovať samostatne mimo verejnej skládky prostredníctvom špecializovaných zberných miest. Pri likvidácii výrobku obsahujúceho batérie, ktoré nemôže vybrať používateľ, musí výber nevymeniteľných batérií vykonať odborný technik.
- PL** Należy we własnym zakresie sprawdzić informacje o lokalnych placówkach odbierających zużyte produkty elektryczne i elektroniczne oraz opakowania po nich. Należy bezwzględnie przestrzegać lokalnych przepisów zakazujących wyrzucania urządzeń i opakowań razem z odpadami komunalnymi. Właściwe usunięcie zużytego opakowania, produktu i/lub baterii pomoże uniknąć potencjalnych szkodliwych skutków dla środowiska naturalnego i zdrowia ludzi. Baterii nie wolno wyrzucać wraz z odpadami komunalnymi. Należy je zanościć do wyznaczonych punktów zbiórki. W przypadku utylizacji produktu zawierającego baterie niepodlegające wymianie przez użytkownika, powinny one zostać usunięte przez specjalistę.
- RO** Informați-vă cu privire la sistemul local de colectare, separare și eliminare a deșeurilor pentru produsele electrice și electronice și ambalajele acestora. Acționați în conformitate cu regulile locale și nu eliminați produsele vechi și ambalajele împreună cu deșeurile menajere obișnuite. Eliminarea corespunzătoare a ambalajelor, a produsului și/sau a bateriilor va ajuta la prevenirea consecințelor potențiale negative pentru mediu și sănătatea umană. Bateriile trebuie eliminate separat de sistemul municipal de gestionare a deșeurilor prin intermediul unităților de colectare desemnate. Atunci când eliminați un produs care conține baterii ce nu pot fi înlocuite de utilizator, aceste baterii trebuie îndepărtate de către un specialist.
- SQ** Informohuni për sistemin lokal të hedhjes së mbeturinave, ndarjes dhe grumbullimit për produktet elektrike dhe elektronike dhe paketimin. Veproni në përputhje me rregullat lokale dhe mos e hidhni produktin e vjetër dhe paketimin me mbeturinat e zakonshme të shtëpisë. Hedhja e duhur e paketimit, produktit dhe/ose baterive do të ndihmojë në parandalimin e pasojave të mundshme negative për mjedisin dhe shëndetin njerëzor. Bateritë duhet të hidhen veçmas nga rryma e mbeturinave urbane nëpërmjet pikave të autorizuar të grumbullimit. Kur hidhni një produkt që përmban bateri që nuk ndërrohen nga përdoruesi, këto bateri duhet të hiqen nga një profesionist.
- LV** Lūdzu, iepazīstieties ar informāciju par vietējo atkritumu likvidēšanas, nošķiršanas un savākšanas sistēmu elektriskām un elektroniskām precēm un iepakojumiem. Rīkojieties atbilstoši vietējiem noteikumiem un nelikvidējiet nolietotos izstrādājumus un iepakojumus kopā ar parastajiem sadzīves atkritumiem. Izstrādājuma un/vai bateriju pareiza likvidēšana palīdzēs novērst iespējamu nelabvēlīgu ietekmi uz vidi un cilvēku veselību. Baterijas jālikvidē atsevišķi no pašvaldību atkritumu plūsmas ar šim nolūkam īpaši paredzētu savākšanas uzņēmumu starpniecību. Likvidējot produktu, kas satur baterijas, kuras lietotājs nevar nomainīt, profesionālim ir jāizņem šīs baterijas.
- LT** Susipažinkite su vietinė elektros ir elektroninių gaminių bei pakuočių atliekų šalinimo, rūšiavimo ir surinkimo sistema. Laikykites vietinių taisyklių ir neišmeskite seno gaminio bei pakuotės kartu su įprastomis buitinėmis atliekomis. Tinkamas pakuotės, gaminio ir (arba) baterijų išmetimas padės išvengti galimų neigiamų pasekmių aplinkai ir žmonių sveikatai. Baterijos turi būti išmestos atskirai nuo komunalinių atliekų srauto tam skirtais surinkimo įrenginiais. Išmetant gaminį, kuriame yra naudotojo nekeičiamų baterijų, naudotojų nekeičiamas baterijas turi išimti profesionalas.
- ET** Viige ennast kurssi kohaliku elektri- ja elektroonikatoodeete ning pakendite kasutusest kõrvaldamise, sorteerimise ja kogumise süsteemiga. Järgige kohalikke eeskirju järgi ning ärge visake vana toodet ega pakendeid olmejäätmete hulka. Pakendi ja vana toote ja/või akude nõuetekohane kasutusest kõrvaldamine aitab vältida võimalikke negatiivset mõju keskkonnale ja inimeste tervisele. Akud tuleb kasutusest kõrvaldada olmejäätmetest eraldi ning viia selleks ette nähtud kogumiskohta. Kui kõrvaldate kasutusest toote, mis sisaldab akusid, mida kasutaja ei saa vahetada, peab need akud tootest eemaldama kvalifitseeritud spetsialist.
- RU** С информацией о местных системах раздельного сбора и утилизации таких отходов, как электрическое и электронное оборудование, а также упаковка, рекомендуется ознакомиться самостоятельно. Соблюдайте региональные нормативные требования и не выбрасывайте отслужившее изделие вместе с обычным бытовым мусором. Правильная утилизация отслужившего изделия и/или батарей поможет уменьшить негативные последствия для окружающей среды и здоровья людей. Батареи следует утилизировать отдельно от бытовых отходов через специальные пункты сбора. Если изделие оснащено батареями, не предназначенными для самостоятельной замены, их должен извлечь специалист.
- UA** Рекомендуємо самостійно ознайомитися з інформацією про місцеві системи сортування й утилізації відходів електричного та електронного обладнання і їхнього пакування. Дійте відповідно до місцевих правил і не викидайте старий виріб і його упаковку разом зі звичайними побутовими відходами. Правильна утилізація упаковки, виробу та/або акумуляторів допоможе запобігти потенційним негативним наслідкам для довкілля та здоров'я людей. Акумулятори слід утилізувати окремо від потоку комунальних відходів через спеціальні місця для збору. Під час утилізації виробу, що містить акумулятор, який не може замінювати користувач, такий акумулятор має вилучати професіонал. УВАГА: Нижче ви знайдете всі пояснення з числовими посиланнями на значки, відповідно, перед цими інструкціями з безпеки:

xitanium

© 2026 Signify Holding. All rights reserved. The information provided herein is subject to change, without notice.
Signify does not give any representation or warranty as to the accuracy or completeness of the information included herein
and shall not be liable for any action in reliance thereon. The information presented in this document is not intended as any
commercial offer and does not form part of any quotation or contract, unless otherwise agreed by Signify.
All trademarks are owned by Signify Holding or their respective owners.